

DX³ isolators

ISs for AC applications upto 125A



4065 00

4065 10

4065 20

Technical characteristics p. 45

Isolators for AC applications upto 125 A
 ISI marked as per IEC 60947-3
 Integrated label holder
 Ergonomic red color dolly
 Sliding bottom clamp
 Double break mechanism
 Improved air channels
 Color coded On/Off indication on dolly
 Biconnect lower terminals
 IP 20 protected terminals
 Sliding shutters

| Pack | Cat.Nos | Isolators | Number of modules |
|--------|----------------|--------------------------------------|-------------------|
| | | 2 pole 415 V\sim | |
| | | Nominal rating In (A) | |
| 1/5/60 | 4065 00 | 32 | 2 |
| 1/5/60 | 4065 01 | 40 | 2 |
| 1/5/60 | 4065 02 | 63 | 2 |
| 1/5/60 | 4065 04 | 100 | 2 |
| 1/5/60 | 4065 05 | 125 | 2 |
| | | 3 pole 415 V\sim | |
| 1/40 | 4065 09 | 32 | 3 |
| 1/40 | 4065 10 | 40 | 3 |
| 1/40 | 4065 11 | 63 | 3 |
| 1/40 | 4065 13 | 100 | 3 |
| 1/40 | 4065 14 | 125 | 3 |
| | | 4 pole 415 V\sim | |
| 1/32 | 4065 18 | 32 | 4 |
| 1/32 | 4065 19 | 40 | 4 |
| 1/32 | 4065 20 | 63 | 4 |
| 1/32 | 4065 22 | 100 | 4 |
| 1/32 | 4065 23 | 125 | 4 |

DX³ RCCBs

RCCBs for AC applications upto 63 A



4118 51

4118 77

4118 93

Technical characteristics p. 46-51

ISI marked as per IS 12640-1
 Integrated label holder
 Ergonomic Grey color dolly
 Sliding bottom clamp
 Color coded On/Off indication on dolly
 Biconnect lower terminals
 IP 20 protected terminals
 35 sq mm terminals
 Sliding shutters

| Pack | Cat.Nos | DX ³ RCCBs | Number of modules |
|--------|----------------|---|-------------------|
| | | 2 pole 240 V\sim | |
| | | 30 mA | |
| | | Nominal rating In (A) | |
| 1/5/60 | 4118 51 | 25 | 2 |
| 1/5/60 | 4118 52 | 40 | 2 |
| 1/5/60 | 4118 53 | 63 | 2 |
| | | 100 mA | |
| 1/5/60 | 4118 56 | 25 | 2 |
| 1/5/60 | 4118 57 | 40 | 2 |
| 1/5/60 | 4118 58 | 63 | 2 |
| | | 300 mA | |
| 1/5/60 | 4118 61 | 25 | 2 |
| 1/5/60 | 4118 62 | 40 | 2 |
| 1/5/60 | 4118 63 | 63 | 2 |
| | | 4 pole 415 V\sim | |
| | | 30 mA | |
| 1/32 | 4118 76 | 25 | 4 |
| 1/32 | 4118 77 | 40 | 4 |
| 1/32 | 4118 78 | 63 | 4 |
| | | 100 mA | |
| 1/32 | 4118 81 | 25 | 4 |
| 1/32 | 4118 82 | 40 | 4 |
| 1/32 | 4118 83 | 63 | 4 |
| | | 300 mA | |
| 1/32 | 4118 86 | 25 | 4 |
| 1/32 | 4118 87 | 40 | 4 |
| 1/32 | 4118 88 | 63 | 4 |
| | | 4 pole 415 V\sim, A-S | |
| | | 300 mA | |
| 1/5/60 | 4118 91 | 25 | 4 |
| 1/5/60 | 4118 92 | 40 | 4 |
| 1/5/60 | 4118 93 | 63 | 4 |
| | | 2 pole 240 V\sim, HPI | |
| | | 30 mA | |
| 1/5/60 | 4118 71 | 25 | 2 |
| 1/5/60 | 4118 72 | 40 | 2 |
| 1/5/60 | 4118 73 | 63 | 2 |
| | | 4 pole 415 V\sim, HPI | |
| | | 30 mA | |
| 1/32 | 4118 96 | 25 | 4 |
| 1/32 | 4118 97 | 40 | 4 |
| 1/32 | 4118 98 | 63 | 4 |

Technical data

| | | |
|---------------------------------|--|---|
| Specifications | IS/IEC 60898-1 2002 | |
| Number of poles | SP, SPN, DR, TR, TPN, FP | |
| Characteristics | C & D Curve | |
| Breaking capacity | 10 kA 0.5 A to 63 A as per IS/IEC 60898-1 2002 16 kA for 0.5 A to 25 A as per IEC 60947-2 | |
| Rated voltage | 230 V/400 V | |
| Current limitation class | Class 3 | |
| Frequency | 50 Hz/60 Hz | |
| Minimum operating voltage | 12 V AC/DC | |
| Enclosures | Polyester self extinguishing, heat and fire resistant according to IEC 60898-1, glow-wire test at 960 °C for external parts made of insulating material necessary to retain in position current-carrying parts and parts of protective circuit (650 °C for all other external parts made of insulating material) | |
| Mounting position | Vertical / Horizontal / Upside down / On the side | |
| Fixing | On symmetric rail EN/IEC 60715 or DIN 35 | |
| Maximum cable size | Top/Bottom | 1 x 1.5 mm ² to 35 mm ² |
| | Rigid cable | 2 x 1.5 mm ² to 16 mm ² |
| | Top/Bottom | 1 x 1.5 mm ² to 25 mm ² |
| | Flexible cable | 2 x 1.5 mm ² to 10 mm ² |
| Applied connection torque | Recommended : 2.5 Nm Minimum : 2 Nm Maximum: 3 Nm | |
| Mechanical endurance | 20000 operations without load | |
| Electrical endurance | 10000 operations with load (under $I_n \cdot \cos \phi = 0.9$) 2000 operations under I_n , DC current | |
| Permissible ambient temperature | 0.5 to 63A - Maximum + 70 °C Minimum -25 °C | |

| | | |
|---------------------------------|--|---|
| Specifications | IEC 60947-2 | |
| Number of poles | SP, DP, TR, FP | |
| Breaking capacity | 10 kA 80 A to 125 A as per IEC 60898 16 kA for 80 A to 125 A as per IEC 60947-2 | |
| Rated voltage | 230 V/400 V | |
| Current limitation class | Class 3 | |
| Frequency | 50 Hz/60 Hz | |
| Minimum operating voltage | 12 V AC/DC | |
| Enclosures | Polyester self extinguishing, heat and fire resistant according to IEC 60898-1, glow-wire test at 960 °C for external parts made of insulating material necessary to retain in position current-carrying parts and parts of protective circuit (650 °C for all other external parts made of insulating material) | |
| Mounting position | Vertical / Horizontal / Upside down / On the side | |
| Fixing | On symmetric rail EN/IEC 60715 or DIN 35 | |
| Maximum cable size | Top/Bottom | 1 x 1.5 mm ² to 50 mm ² |
| | Rigid cable | 2 x 1.5 mm ² to 25 mm ² |
| | Top/Bottom | 1 x 1.5 mm ² to 35 mm ² |
| | Flexible cable | 2 x 1.5 mm ² to 20 mm ² |
| Applied connection torque | Recommended : 2.5 Nm Minimum : 2 Nm Maximum: 3 Nm | |
| Mechanical endurance | 20000 operations without load | |
| Electrical endurance | 10000 operations with load (under $I_n \cdot \cos \phi = 0.9$) 2000 operations under I_n , DC current | |
| Permissible ambient temperature | 80 to 125 A - Maximum + 70 °C Minimum -25 °C | |

Power dissipated in Watt per pole at I_n

Circuit breakers C and D curves

| | | | | | | | | | | | | | | | | | |
|-----------|-----|---|-----|---|---|---|-----|-----|-----|-----|----|-----|-----|-----|----|-----|-----|
| I_n (A) | 0,5 | 1 | 1,6 | 2 | 3 | 4 | 5 | 6 | 7,5 | 10 | 16 | 20 | 25 | 32 | 40 | 50 | 63 |
| 1P ÷ 4P | 1.7 | 2 | 2 | 2 | 2 | 2 | 2.1 | 1.1 | 1.4 | 1.8 | 2 | 2.2 | 2.7 | 3.2 | 4 | 4.5 | 5.5 |

| | | | | | | | | | | | | | | | | |
|----------------------------------|---|---|---|---|---|---|---|---|---|-----|-----|-----|---|-----|---|----|
| Permitted limit as per IEC 60898 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3.5 | 4.5 | 4.5 | 6 | 7.5 | 9 | 13 |
|----------------------------------|---|---|---|---|---|---|---|---|---|-----|-----|-----|---|-----|---|----|

 Impedance per pole (Ω) = $\frac{P \text{ dissipated}}{I_n^2}$

| I_n (A) | Ambient Temperature / I_n | | | | | | | | | |
|-----------|-----------------------------|--------|------|-------|-------|-------|-------|-------|-------|-------|
| | -25 °C | -10 °C | 0 °C | 10 °C | 20 °C | 30 °C | 40 °C | 50 °C | 60 °C | 70 °C |
| 0,5 | 0.62 | 0.6 | 0.57 | 0.55 | 0.52 | 0.5 | 0.47 | 0.42 | 0.40 | 0.38 |
| 1 | 1.5 | 1.4 | 1.3 | 1.2 | 1.1 | 1 | 0.9 | 0.8 | 0.7 | 0.6 |
| 2 | 2.8 | 2.6 | 2.5 | 2.3 | 2.2 | 2 | 1.9 | 1.8 | 1.7 | |
| 3 | 3.8 | 3.6 | 3.5 | 3.3 | 3.2 | 3.0 | 2.9 | 2.8 | 2.7 | 2.6 |
| 4 | 4.5 | 4.2 | 4.0 | 3.9 | 3.7 | 3.5 | 3.4 | 3.3 | 3.2 | 3.1 |
| 5 | 6.4 | 6.0 | 5.8 | 5.5 | 5.3 | 5.0 | 4.8 | 4.7 | 4.5 | 4.6 |
| 6 | 7.5 | 7.0 | 6.6 | 6.4 | 6.2 | 6.0 | 5.8 | 5.6 | 5.4 | 5.3 |
| 10 | 12.5 | 11.5 | 11.1 | 10.7 | 10.3 | 10.0 | 9.7 | 9.3 | 9.0 | 8.7 |
| 16 | 20.0 | 18.7 | 18.0 | 17.3 | 16.6 | 16.0 | 15.4 | 14.7 | 14.1 | 13.5 |
| 20 | 25.0 | 23.2 | 22.4 | 21.6 | 20.8 | 20.0 | 19.2 | 18.4 | 17.6 | 16.8 |
| 25 | 31.5 | 29.5 | 28.3 | 27.2 | 26.0 | 25.0 | 24.0 | 22.7 | 21.7 | 20.7 |
| 32 | 41.0 | 37.8 | 36.5 | 34.9 | 33.3 | 32.0 | 30.7 | 29.1 | 27.8 | 26.5 |
| 40 | 51.0 | 48.0 | 46.0 | 44.0 | 42.0 | 40.0 | 38.0 | 36.0 | 34.0 | 32.0 |
| 50 | 64.0 | 60.0 | 57.5 | 55.0 | 52.5 | 50.0 | 47.5 | 45.0 | 42.5 | 40.0 |
| 63 | 80.6 | 75.6 | 72.5 | 69.9 | 66.1 | 63.0 | 59.8 | 56.1 | 52.9 | 49.7 |

Choice of DX³ MCBs for capacitor banks

This table shows the rated current of MCBs to be used when controlling capacitor banks so as to guarantee its function and shortcircuit protection.

Overload protection is not necessary since these installations cannot be overloaded.

This data refers to shortcircuit protection in absence of harmonics or heavy transitory currents.

| Power of capacitor bank in kVAR | DX ³ MCB rating in amps | | | |
|---------------------------------|------------------------------------|-------------------|--------------------|-------------------|
| | C characteristic | | D characteristic | |
| | Single phase 240 V | Three phase 415 V | Single phase 240 V | Three phase 415 V |
| 0,5 | 10 | 6 | 3 | 1 |
| 1 | 20 | 6 | 6 | 2 |
| 1,5 | 32 | 10 | 10 | 3 |
| 2,5 | 40 | 16 | 10 | 4 |
| 3 | 50 | 16 | 16 | 4 |
| 3,5 | 63 | 20 | 16 | 6 |
| 4 | 63 | 25 | 16 | 6 |
| 4,5 | ... | 25 | 20 | 10 |
| 5 | ... | 32 | 20 | 10 |
| 5,5 | ... | 32 | 25 | 10 |
| 6 | ... | 32 | 25 | 10 |
| 6,5 | ... | 40 | 25 | 10 |
| 7 | ... | 40 | 32 | 10 |
| 7,5 | ... | 50 | 32 | 16 |
| 8 | ... | 50 | 32 | 16 |
| 8,5 | ... | 50 | 40 | 16 |
| 9 | ... | 50 | 40 | 16 |
| 9,5 | ... | 63 | 40 | 16 |
| 10 | ... | 63 | 40 | 16 |
| 10,5 | 80 | 63 | 60 | 16 |
| 11 | 80 | ... | 50 | 16 |
| 11,5 | 80 | ... | 50 | 16 |
| 12 | 80 | ... | 50 | 20 |
| 12,5 | 80 | ... | 50 | 20 |
| 13 | 100 | ... | 63 | 20 |
| 13,5 | 100 | ... | 63 | 20 |
| 14 | 100 | ... | 63 | 20 |
| 14,5 | 100 | ... | 63 | 25 |
| 15 | 100 | ... | 63 | 25 |
| 15,5 | 100 | ... | ... | 25 |
| 16 | 100 | ... | ... | 25 |
| 16,5 | 125 | ... | ... | 25 |
| 17 | 125 | ... | ... | 25 |
| 17,5 | 125 | ... | ... | 25 |
| 18 | 125 | ... | ... | 32 |
| 18,5 | 125 | ... | ... | 32 |
| 19 | 125 | ... | ... | 32 |
| 19,5 | 125 | ... | ... | 32 |
| 20 | 125 | ... | ... | 32 |
| 20,5 | ... | ... | ... | 32 |
| 21 | ... | ... | ... | 32 |
| 21,5 | ... | ... | ... | 32 |
| 22 | ... | ... | ... | 32 |
| 22,5 | ... | ... | ... | 32 |
| 23 | ... | ... | ... | 32 |
| 23,5 | ... | ... | ... | 40 |
| 24 | ... | ... | ... | 40 |
| 24,5 | ... | ... | ... | 40 |
| 25 | ... | ... | ... | 40 |
| 25,5 | ... | ... | ... | 40 |
| 26 | ... | ... | ... | 40 |
| 26,5 | ... | ... | ... | 40 |
| 27 | ... | ... | ... | 40 |
| 27,5 | ... | ... | ... | 40 |
| 28 | ... | ... | ... | 40 |
| 28,5 | ... | ... | ... | 40 |
| 29 | ... | ... | ... | 50 |
| 29,5 | ... | ... | ... | 50 |
| 30 | ... | ... | ... | 50 |
| 30,5 | ... | 80 | ... | 50 |
| 31 | ... | 80 | ... | 50 |
| 31,5 | ... | 80 | ... | 50 |
| 32 | ... | 80 | ... | 50 |
| 32,5 | ... | 80 | ... | 50 |
| 33 | ... | 80 | ... | 50 |
| 33,5 | ... | 80 | ... | 50 |
| 34 | ... | 80 | ... | 50 |
| 34,5 | ... | 80 | ... | 50 |
| 35 | ... | 80 | ... | 50 |
| 35,5 | ... | 80 | ... | 50 |
| 36 | ... | 80 | ... | 50 |
| 36,5 | ... | 80 | ... | 63 |
| 37 | ... | 80 | ... | 63 |
| 37,5 | ... | 80 | ... | 63 |
| 38 | ... | 80 | ... | 63 |
| 38,5 | ... | 80 | ... | 63 |
| 39 | ... | 100 | ... | 63 |
| 39,5 | ... | 100 | ... | 63 |
| 40 | ... | 100 | ... | 63 |
| 40,5 | ... | 100 | ... | 63 |
| 41 | ... | 100 | ... | 63 |
| 41,5 | ... | 100 | ... | 63 |
| 42 | ... | 100 | ... | 63 |
| 42,5 | ... | 100 | ... | 63 |
| 43 | ... | 100 | ... | 63 |
| 43,5 | ... | 100 | ... | 63 |
| 44 | ... | 100 | ... | 63 |
| 44,5 | ... | 100 | ... | 63 |
| 45 | ... | 100 | ... | 63 |
| 45,5 to 48 | ... | 100 | ... | ... |
| 48,5 to 60 | ... | 125 | ... | ... |

■ Technical data

| | |
|-----------------------------------|---|
| Specification | SPEC/E-12/1/14 |
| Number of poles | 1 |
| Characteristic | As applicable |
| Line terminal | Indicated by LN |
| Load terminal | Indicated by LD |
| Rated Voltage | 130 V _~ |
| Max. Operating Voltage | 440 V _~ |
| Min. Operating Voltage | 12 V _~ |
| Voltage resistance | > 2500 V _~ |
| Enclosure | Moulded out of DMC (thermoset plastic) bone grey colour, flamability class V1-UL94, Tracking index - 600+volts |
| Dolly | Black, can be locked or lead sealed in ON or OFF position |
| Fire retardent grade of enclosure | V |
| Mounting position | Optional |
| Fixing | Snap fixing on standard DIN RAIL profile EN 50023 - 35 x 7.5 |
| Terminals | With flat Cu terminal extension mounting as per skel 3700. Current Carring Capacity 100 Amp. Max. Continuous. |
| On-Off indication | MCB in on position when marking I-ON appears on dolly. MCB in OFF position when making O-Off appears on dolly. |
| Mech. Service Life | 10000 operation |
| Electrical Endurance | 6000 operation at rated load |
| Climate resistance : | 25/95-40/93 (°C/RH) |
| Permissible Ambient : | T max. - 45 °C, T min - 25 °C temperature |
| Shock resistance | 20 g minimum 20 impacts duration of shock 13 ms. |
| Vibration resistance | 3 g |

As per international STD, MCB in 'ON' condition when dolly is in upper position.

DX³

MCBs


Technical data

Correct polarity connections for DC MCBs


• Supply terminals

When supply is given at lower terminals

Single pole MCB

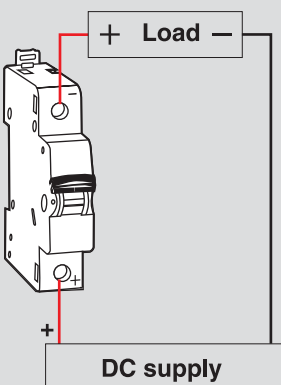


Double pole MCB

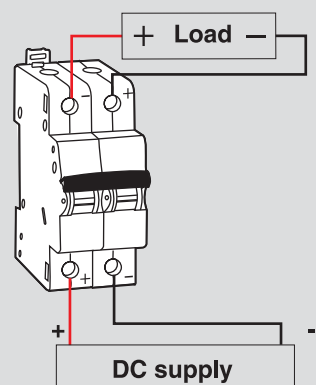


• Supply terminals

When supply is given at upper terminals

Single pole MCB

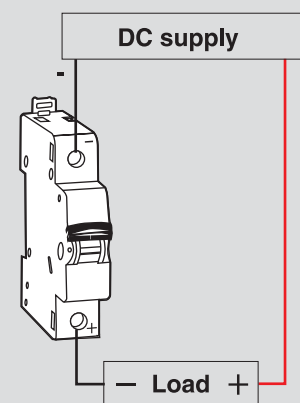

Double pole MCB

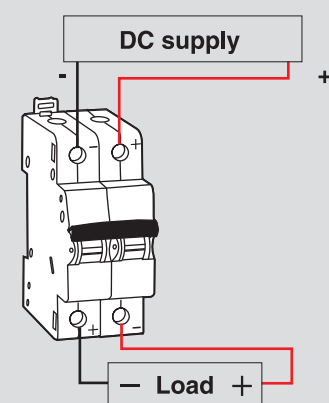

Derating of MCB for use with fluorescent lights

Ferromagnetic and electronic ballasts have a high inrush current for a short time. These currents can cause the tripping of circuit breakers. At the time of the installation, it should take into account the maximum number of ballasts per circuit breaker that the manufacturers of lamps and ballasts indicate in their catalogues.

Influence of the altitude

| | ≤2000 m | 3000 m | 4000 m | 5000 m |
|-------------------------|---------|--------|--------|--------|
| Dielectric holding | 3000 V | 2500 V | 2000 V | 1500 V |
| Max operational voltage | 400 V | 400 V | 400 V | 400 V |
| Derating at 30 °C | none | none | none | none |

Derating of MCBs function of the number of devices side by side:

When several MCBs are juxtaposed and operate simultaneously, the thermal evacuation of the poles is limited. This results in an increase in operating temperature of the circuit breakers which can cause unwanted tripping. It is recommended to apply the following coefficients to the rated currents.

Influence of the altitude

| Number of circuit breakers side by side | Coefficient |
|---|-------------|
| 2 - 3 | 0.9 |
| 4 - 5 | 0.8 |
| 6 - 9 | 0.7 |
| ≥10 | 0.6 |

These values are given by the recommendation of IEC 60439-1, NF C 63421 and EN 60439-1 standards.


Tripping characteristics

Standards has established different tripping characteristics depending on minimum and maximum values of magnetic trip.

| DX ³ MCB | Type | Im1 | Im2 | Typical application |
|---------------------|------|-------|-------|--|
| 0.5 A to 63 A | D | 10 In | 20 In | Protection of cable and appliance which has very high starting currents. |
| 6 A to 63 A | C | 5 In | 10 In | Protection of cable used for lighting load, power load and induction loads with high starting current. |

Im1 - hold limit
Im2 - Trip limit

DX³ MCBs versus zero point extinguishing MCBs

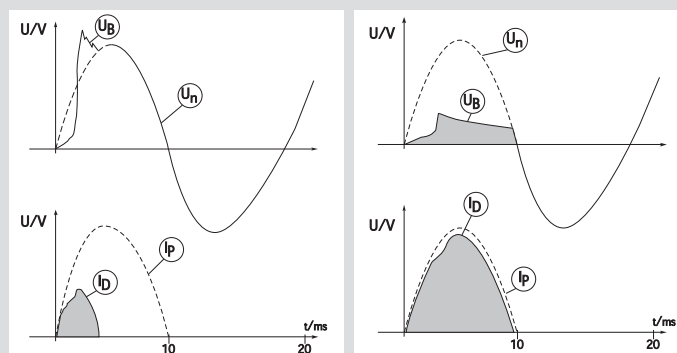

Current limiting DX³ MCB

Zero point extinguishing MCB

Un = Mains Voltage
UB = Arc Voltage
ID = Let-through short circuit current
IP = Prospective short circuit current

Technical data

Association of protection devices

Association is the technique by which the breaking capacity of a MCB is increased by coordinating it with another protection device, placed upstream. This coordination makes it possible to use a protection device with a breaking capacity which is lower than the maximum prospective short-circuit current at its installation point

The breaking capacity of a protection device must be at least equal to the maximum short-circuit which may occur at the point at which this device is installed.

In exceptional cases, the breaking capacity may be lower than the maximum prospective short-circuit, as long as:


- It is associated with a device upstream which has the necessary breaking capacity at its own installation point
- The downstream device and the trunking being protected can withstand the power limited by the association of the devices.

Association therefore leads to substantial savings.

The association values given in the tables on the following pages are based on laboratory tests carried out in accordance with IEC 60947-2.

Note: In the case of single phase circuits (protected by P+N or 2P MCBs) in a 415 V AC supply, supplied upstream by a 3-phase circuit, it is advisable to use the association tables for 230 V.

Example of association

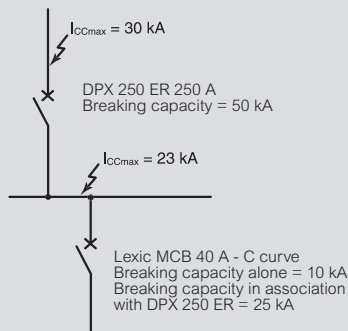

3-level association


An association may be created on three levels if one of the conditions below is met.

- The upstream device A must have an adequate breaking capacity at its installation point. Devices B and C are associated with device A. Simply check that the association values B+A and C+A have the necessary breaking capacity.

In this case, there is no need to check the association between devices B and C.

- The association is made between successive devices: Upstream device A, which has an adequate breaking capacity at its installation point, device C is associated with device B which is in turn associated with device A.

Simply check that the association values C+B and B+A have the necessary breaking capacity. In this case, there is no need to check the association between devices A and C.

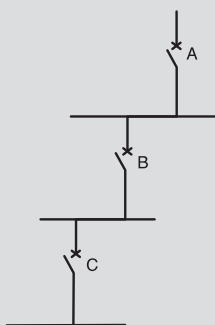


Association in IT connection systems

The values given in the tables should only be used for TN and TT systems.

Although this practice is not widely used, these values may also be used for installations with IT systems. It is therefore advisable to check that each protection device, on its own, can break, on a single pole, the maximum double fault current at the point in question.


Association between distribution boards

Association applies to devices installed in the same distribution board as well as in different boards. It is therefore generally possible to benefit from the advantages of the association between devices located, for example, in a main distribution board and in a secondary board.

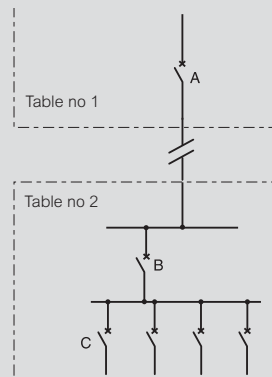

MCB - switch association


The switches must be systematically protected by an MCB placed upstream. There is considered to be protection against overloads if the rating of switch I is at least equal to that of the upstream MCB, D. If this is not the case, the thermal stresses (devices and conductors) must be checked. The tables on the following pages give the breaking capacity limits of the MCB - switch associations.

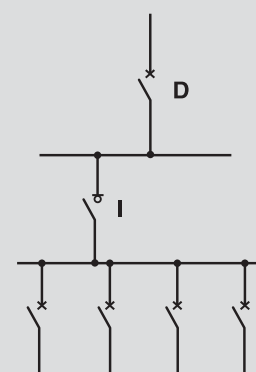

Discrimination of protection devices

Discrimination is a technique which consists of coordinating the protection in such a way that a fault on one circuit only trips the protection placed at the head of that circuit, thus avoiding rendering the remainder of the installation inoperative. Discrimination improves continuity of service and safety of the installation

Discrimination rules are set by the regulations concerning public buildings and for safety installations in general.



Discrimination between A and B is said to be "total" if it is provided up to the value of the maximum prospective short-circuit at the point at which B is installed.


By extension, in the tables on the following pages, total discrimination, indicated by T, means that there is discrimination up to the breaking capacity of device B.

Discrimination between A and B is said to be "partial" in the other cases.

The discrimination limit (given in the following tables) is therefore defined. This gives the short-circuit current value below which only MCB B will open and above which MCB A will also open.

There are a number of techniques for providing discrimination:

- Current discrimination, used for terminal circuits which have low short-circuits.
- Time discrimination, provided by a delay on tripping the upstream MCB
- Logical discrimination, a variant of time discrimination, used on electronic MCBs via a special link between the devices.

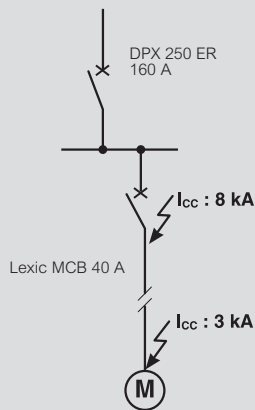

Since almost all faults occur during use, partial discrimination may be adequate if the discrimination limit is higher than the value of the maximum short-circuit which may occur at the point of use (or at the end of the trunking). This is referred to as "operating discrimination". This technique is very often adequate, more economical and less restricting in terms of implementation.

The discrimination limit for the association DPX 250 ER (160 A) with Lexic MCB 40 A (C curve) is 6 kA. Since the prospective ISC at the point of installation is 8 kA, the discrimination is not total. However, there is discrimination at the point of use at which the prospective short-circuit is only 3 kA.

Current discrimination

This technique is based on the offset of the intensity of the tripping curves of the upstream and downstream MCBs. It is checked by comparing these curves and checking that they do not overlap. It applies for the overload zone and the short-circuit zone, and the further apart the ratings of the devices, the better the discrimination.

- On overloads

To have discrimination in the overload zone, the ratio of the setting currents (I_r) must be at least 2.

- On short-circuits

To have discrimination in the short circuit zone, the ratio of the magnetic setting currents (I_m) must be at least 1.5.


The discrimination limit is then equal to the magnetic release current I_{mA} of the upstream MCB. The discrimination is then total as long as I_{SCB} is less than I_{mA} .

Current discrimination is therefore very suitable for terminal circuits where the short-circuits are relatively weak.

In other cases, time discrimination may be used together with current discrimination.


Current discrimination

The discrimination is total for I_{SCB}

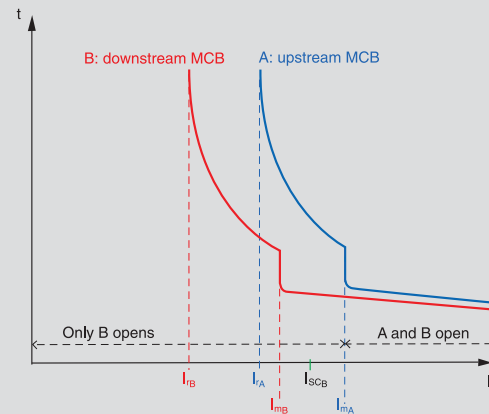

I_{SCB} : maximum short-circuit at the point at which MCB B is installed


When the downstream MCB B is a limiting device, the short-circuit current is limited in terms of time and amplitude. The discrimination is therefore total if the limited current I_{SCB} , which device B allows to pass, is lower than the tripping current of device A

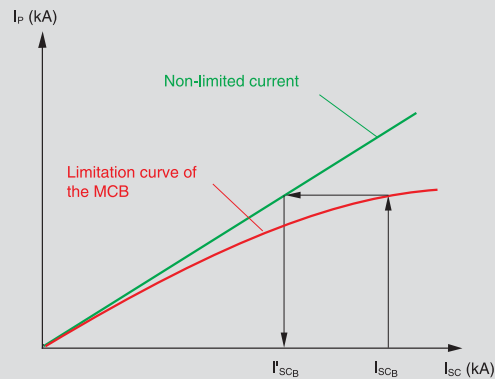

I_{SCB} : prospective short-circuit at the point at which the device is installed
 I'_{SCB} : short-circuit limited by device B

Time discrimination

This technique is based on the offset of the times of the tripping curves of the MCBs in series. It is checked by comparing the curves and is used for discrimination in the short-circuit zone. It is also used in addition to current discrimination in order to obtain discrimination beyond the magnetic setting current of the upstream MCB (I_{mA}).



The following is necessary:

- It must be possible to set a time delay on the upstream MCB
- The upstream MCB must be able to withstand the short-circuit current and its effects for the whole period of the time delay
- The trunking through which this current passes must be able to withstand the thermal stresses (I^2t).

The non-tripping time of the upstream device must be longer than the breaking time (including any time delay) of the downstream device.

DPX MCBs have a number of time delay setting positions for creating discrimination with a number of stages.

DX³

MCBs

Selection chart*

DX³ MCBs (10 kA) and RCBOs 3 phase motor application

| Motor H.P. | KW | MCB rating (A) | |
|------------|-------|----------------|-------|
| | | Star Delta | DOL |
| 1 | 0.75 | - | 1.6 A |
| 1.5 | 1.10 | - | 2 A |
| 2 | 1.50 | - | 3 A |
| 3 | 2.25 | - | 4 A |
| 4 | 3.00 | - | 10 A |
| 5 | 3.75 | 10 A | 10 A |
| 6 | 4.50 | 10 A | 10 A |
| 7.5 | 5.50 | 16 A | 16 A |
| 10 | 7.50 | 16 A | 20 A |
| 12.5 | 9.30 | 20 A | 25 A |
| 15 | 11.00 | 25 A | 32 A |
| 17.5 | 13.00 | 25 A | 32 A |
| 20 | 15.00 | 40 A | 40 A |
| 25 | 18.50 | 40 A | 50 A |
| 30 | 22.50 | 50 A | 63 A |
| 35 | 26.00 | 63 A | - |

For MCB/RCBO ratings :

Single phase = $P = VI$

Three phase = $P = \sqrt{3} VI \cos \phi = 1.732 \times VI \times 0.8$

Note : One lighting circuit can have upto 800 W or upto 10 points.

One power circuit can have upto 3000 W or upto 2 power points.

* The data given above is only for guidance.

The exact rating must be selected only after considering the motor characteristics.

Technical data

Isolators

| | | |
|---|--|---|
| Specifications | IEC 60947-3 | |
| Number of poles | DP, TP, FP | |
| Utilization category | AC22A | |
| Rated operational voltage and frequency | 415 V, 50/60 Hz | |
| Insulation voltage Ui | 500 V AC | |
| Impulse voltage Uimp | 6 kV | |
| Short circuit making capacity Icm | 1000 A | |
| Endurance | Electrical - 1500 operations with load AC22A Mechanical - 10000 operation | |
| Mounting position | Vertical / Horizontal / Upside down / On the side | |
| Fixing | On symmetric rail EN/IEC 60715 or DIN 35 | |
| Maximum cable size | Top/Bottom | 1 x 1.5 mm ² to 35 mm ² |
| | Rigid cable | 2 x 1.5 mm ² to 16 mm ² |
| | Top/Bottom | 1 x 1.5 mm ² to 25 mm ² |
| | Flexible cable | 2 x 1.5 mm ² to 10 mm ² |
| Applied connection torque | Recommended : 3 Nm Minimum : 2 Nm Maximum: 3.5 Nm | |
| Permissible ambient temperature | Maximum + 70 °C Minimum -25 °C | |

DX³ RCDS

Technical data for DX³ RCDs

| | RCCB | | |
|--|---|---|--|
| | Type AC | Type A-S | Type Hpi |
| Specification | IS 12640 (part 1) 2008 IEC 61008 - 1 | IEC 61008 - 1 EN 61008 - 1 | EN 61008 - 1 IEC 61008 - 1 |
| No. of modules | - Double pole - Four pole | 2 4 | 2 4 |
| Electrical characteristics | | | |
| Nominal rating I_n (A) | - Double pole - Four pole | 25, 40, 63, 80, 100 25, 40, 63, 80, 100 | 63, 80 25, 40, 63, 80 |
| Rated sensitivity (mA) | - Double pole - Four pole | 30, 100, 300 30, 100, 300 | 300 300 |
| Rated frequency (Hz) | | 50 / 60 | 50 / 60 |
| Rated operating voltage U_e (V AC) | - Double pole - Four pole | 230 230 / 415 | 230 400 |
| Minimum operating voltage (V AC) | | 12 | 12 |
| Minimum operating voltage for test button (V AC)⁽¹⁾ | | | |
| | - Double pole - Four pole | 170 196 | 170 196 |
| Rated insulation voltage U_i (V AC) | - Double pole - Four pole | 250 500 | 250 500 |
| Rated impulse withstand voltage U_{imp} (kV) | | 6 | 6 |
| Breaking capacity | As per IS 12640 (part 1) 2008, IEC 61008 - 1 | | |
| Rated making & breaking capacity (I_m) | | | |
| | - Up to 40 A - From 63 A and above | 500 A 10 x I _n | - 630 A |
| Rated residual making & breaking capacity (I_{Δm}) | | | |
| | - Up to 40 A - From 63 A and above | 1000 A 1000 A | - 1000 A |
| Rated conditional short circuit current (I_{nc}) | | 10000 A | 10000 A |
| Rated conditional residual short circuit current (I_{Δc}) | | 10000 A | 10000 A |
| Rated service short circuit capacity (I_{cs}) | | - | - |
| Rated short circuit capacity (I_{cn}) | | - | - |
| Operating temperature (°C) | | - 25 to 70 | - 25 to 70 |
| Endurance (0.C cycle) | - Mechanical - On load at in X cos φ 0.9 - Via test button - By fault current (sensitivity) | 20,000 10,000 2,000 2,000 | 20,000 10,000 2,000 2,000 |
| Testing | By pressing test button grey dolly will come to OFF position It is recommended to test RCCB once a month | By pressing test button grey dolly will come to OFF position It is recommended to test RCCB once a month | By pressing test button, grey dolly will come to OFF position It is recommended to test RCCB once a month |
| Fault indication | - Earth leakage - Overload and shortcut | Grey dolly will come to OFF position - | Grey dolly will come to OFF position - |
| Resetting | | Switch on grey dolly | Switch on grey dolly |
| Terminals | - Rigid - Flexible | 1 - 35 sq. mm 1 - 25 sq. mm | 1 - 35 sq. mm 1 - 25 sq. mm |
| Type of protection | | | |
| Earth leakage | | • | • |
| Overload | | - | - |
| Short circuit | | - | - |
| Add on electrical accessories* | | | |
| Auxiliary | | • | • |
| Fault signaling | | • | • |
| Shunt trip | | • | • |
| Under voltage | | • | • |
| Over voltage | | • | • |

* - Accessories are mounted on the left hand side of the product.
At a time a maximum of three accessories can be mounted.

⁽¹⁾ - Between phase and neutral


| RCBO | | | | |
|---|---|---|---|--|
| Type AC | Type AC - 2 & 4 modules | Type Hpi | Type A | |
| IS 12640 (part 2) 2008 IEC 61009 - 1 | NFC 61 - 410 EN 61009 - 1 IEC 61009 - 1 | EN 61009 - 1 IEC 61009 - 1 | EN 61009 - 1 IEC 61009 - 1 | |
| 4 | 2 | 2 | - | |
| 7 | 4 | - | 4 | |
| | | | | |
| 6, 10, 16, 25, 32, 40, 63 | 6, 10, 16, 20, 25, 32 | 25, 32, 40 | 25, 32, 40 | |
| 16, 25, 32, 40, 63 | 10, 16, 20, 25, 32 | - | - | |
| 30, 100, 300 | 30, 300 | 30 | 30, 300 | |
| 30, 100, 300 | - | - | - | |
| 50 | 50 | 50 / 60 | 50 / 60 | |
| 230 | 230 | 230 | - | |
| 415 | 415 | - | 415 | |
| 12 | 12 | 12 | 12 | |
| | | | | |
| 170 | 170 | 170 | - | |
| 196 | 196 | - | 196 | |
| 500 | 250 | 250 | - | |
| 500 | 500 | - | 500 | |
| 4 | 6 | 6 | 6 | |
| As per IS 12640 (part 2) 2008, IEC 61009 - 1 | | | | |
| 10000 A | 6000 A | 6000 A | 6000 A | |
| 10000 A | - | - | - | |
| 10000 A | 3000 A | 3000 A | 3000 A | |
| 10000 A | - | - | - | |
| - | - | - | - | |
| - | - | - | - | |
| 7500 A | 6000 A | 6000 A | 6000 A | |
| 10000 A | 6000 A | 6000 A | 6000 A | |
| - 25 to 70 | - 25 to 70 | - 25 to 70 | - 25 to 70 | |
| 20,000 | 20,000 | 20,000 | 20,000 | |
| 10,000 | 10,000 | 10,000 | 10,000 | |
| 1,000 | 1,000 | 1,000 | 1,000 | |
| 1,000 | 1,000 | 1,000 | 1,000 | |
| By pressing test button, black dolly will come to OFF position It is recommended to test RCBO once a month | By pressing test button, black dolly will come to OFF position It is recommended to test RCBO once a month | By pressing test button, black dolly will come to OFF position It is recommended to test RCBO once a month | By pressing test button, black dolly will come to OFF position It is recommended to test RCBO once a month | |
| Black & blue dolly will come to OFF position | Black dolly will come to OFF position & blue indicator will appear on front face window | Black dolly will come to OFF position & blue indicator will appear on front face window | Black dolly will come to OFF position & blue indicator will appear on front face window | |
| Black dolly will come to OFF position | Black dolly will come to OFF position | Black dolly will come to OFF position | Black dolly will come to OFF position | |
| Switch on black dolly | Switch on black dolly | Switch on black dolly | Switch on black dolly | |
| 1 - 35 sq. mm | 0.75 - 16 sq. mm | 0.75 - 16 sq. mm | 0.75 - 16 sq. mm | |
| 1 - 25 sq. mm | 0.75 - 10 sq. mm | 0.75 - 10 sq. mm | 0.75 - 10 sq. mm | |
| | | | | |
| • | • | • | • | |
| • | • | • | • | |
| • | • | • | • | |
| | | | | |
| • | • | • | • | |
| • | • | • | • | |
| • | • | • | • | |
| • | • | • | • | |
| • | • | • | • | |


Technical data


Short-circuit withstanding capacity of RCCBs (in kA)


| RCD downstream | DX ³ MCB upstream | |
|----------------|------------------------------|----|
| 2P | 16 | 10 |
| | 25 | 10 |
| | 40 | 10 |
| | 63 | 10 |
| | 80 | 10 |
| | 100 | 10 |
| 4P | 25 | 10 |
| | 40 | 10 |
| | 63 | 10 |
| | 80 | 10 |
| | 80 | 10 |
| | 100 | 10 |

Marking example :

Type A 

Type AC 

Type A-S 

Type Hpi 

Technical data

Nature and consequences of electrical risks

Direct and indirect contact

All electrical risks for people are the result of direct or indirect contact. What are these contacts? And how can we protect ourselves against them?

All the answers appear in the following section.

Electrical risks do not just concern people : these risks - especially fire affect installations as well. A 500 mA current, for example, flowing through combustible material is sufficient to ignite such material after a certain time. Every electrical installation is subject to current leakages which can vary considerably depending on such factors as the installation's condition, age, environment, etc.

These current leaks may flow through the fabric of the building (trunking, metal girders or other metal components), generating heat which in turn may lead to fire.

Direct contacts

Direct contact is caused by humans and may be due to either carelessness or clumsiness.

What is a direct contact? How can we protect ourselves? Here are the answers...

This is when someone makes contact with a live electrical component of a device or installation.

For example :

- a person inadvertently touching a live cable.
- a child sticking a metal object into a power socket.
- using male/male extensions or unprotected test cables.

In this case only basic protection is effective



Other examples

Someone touching a live busbar in a distribution panel or cabinet, or someone touching flush-mounted electrical trunking with the end of a tool, etc. In this case basic protection plus additional protection is effective.

How can we protect ourselves?

There are two ways (independent of the neutral earthing system) of ensuring that personnel are protected against direct contact.

• Preventing access to live parts where possible.

Basic protection via physical or electrical isolation of live parts.

This protection must ensure that live parts cannot be touched, even inadvertently.

How?

By using barriers, enclosures, closed cabinets which physically or electrically isolate live parts presenting a danger to the user, shuttered sockets, or insulation.

• Additional protection

Must be provided by a 30-mA residual current device such as Lexic range of residual current devices. This protection is required in case the basic protection detailed above fails.

Technical data

Indirect contacts

Indirect contacts are independent of humans : it results from an internal hardware fault.

What is an indirect contact?

How can we protect ourselves? Here are the answers...

What is an indirect contact?

This is when a person makes contact with a metal earthed part which has accidentally been powered up following an insulation fault. This type of contact is very dangerous as, unlike direct contact, it is completely unexpected. For example, a person touching the metal frame of an electrical appliance which has defective insulation may be electrocuted through no fault of their own if the appliance is not protected.

How can we protect ourselves?

There are three possibilities :

- Preventing access to potentially dangerous metal components via class II protection.
- Good connection of all exposed conductive parts to an effective earth.
- A protective RCD according to the neutral earthing system.



A person is in danger of electrocution if the fault current raises the voltage of the accessible metal part above 50 V to earth.

Important note:

Under the Indian Electricity Rules [rules 61 (A), 71 (1) and 73 (1)], installation of an RCCB is mandatory in all installations of 5 KW and above, in all luminous tube signs and X-ray installations. The bureau of Indian standards recommends that RCCBs installed at construction sites, temporary installations, agriculture and horticulture premises, limit the residual current to 30 mA.

Residual current devices, selection and operation

The main function of a residual current device is to ensure that people are protected from any risk of electrocution. It can also ensure protection against risk of fire.

What is the nature of these risks ? What are the consequences ? Here are the answers...

Risks of electrocution-

The dangerous effects of electricity depend on two factors-:

- the flowing time through the human body
- the current value

These two factors are independent and the importance of the risk varies in accordance with the level of each factor.

The dangerous current value through a human body depends on the touch voltage and touch resistance of the human body.

In practice, the current value is defined using a standard "safety" voltage of 50 V. This voltage takes into account the maximum current which can be withstood by a human being with a minimum internal electrical resistance in given conditions. It also takes into account the maximum permissible time for the current to pass through the body without dangerous physio-pathological effects.

50 V is considered as the safe limit of voltage for human body in dry condition.

How does an electrical current affect the human body?

When subject to a voltage, the human body reacts like any other receiver with a given internal resistance. An electrical current passes through the body with three serious risks :

- Locking of the muscles, or tetanisation : the muscles through which the current passes contract and remain contracted : if this includes the rib cage, breathing may be impeded.
- Action on the heart : the cardiac rhythm is completely disrupted (ventricular fibrillation).
- Thermal effects may cause varying levels of damage to body tissue, including severe burns in the case of very high currents.




Examples of electrocution by direct or indirect contact.

Technical data

Effect of current on human body

The standards define the following curves, which take into account the two parameters required to assess the risk :

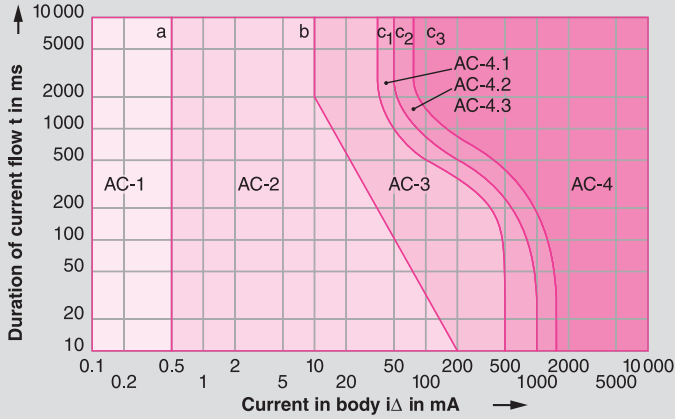

$i\Delta$: current flowing through body.
 t : time taken for current to pass through body.

These curves show the various zones of effect of an alternating current on people : they derive from IEC 60 479 and determine

4 main risk zones

| Zone designation | Physiological effects |
|------------------|--|
| zone AC-1 | Usually no reaction |
| zone AC-2 | Usually no harmful physiological effects |
| zone AC-3 | Usually no organic damage to be expected. Likelihood of cramp like muscular contractions and difficulty in breathing for durations of current-flow longer than 2 s. Reversible disturbances of formation and conduction of impulses in the heart, including atrial fibrillation and transient cardiac arrest without ventricular fibrillation increasing with current magnitude and time |
| zone AC-4 | Increasing with magnitude and time, dangerous pathophysiological effects such as cardiac arrest, breathing arrest and serious burns may occur in addition to the effects of zone-3 |
| zone AC-4.1 | Probability of ventricular fibrillation increasing up to about 5% C1 - C2 |
| zone AC-4.2 | Probability of ventricular fibrillation up to about 50% C2 - C3 |
| zone AC-4.3 | Probability of ventricular fibrillation above 50% |

* For durations of current flow below 10 ms, the limit for the body current at line b remains constant at a value of 200 mA.

A residual current device continuously measures the difference between the value of the input and the output currents. If the value is not equal to zero, this indicates a leak.


When this leak reaches the level at which the differential is set (its sensitivity), the device trips and breaks the circuit.

What are the operating principles of a residual current device?

What are the selection criteria for a residual current device? Here are the answers...

Operating principle of a residual current device

No fault present

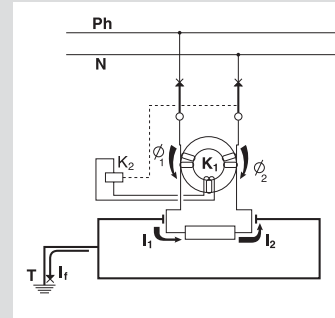

Therefore no current is induced in coil K₁, and coil K₂ is not excited. The contacts do not open. The equipment operates normally


$$I_1 = 0, \text{ thus}$$

$$I_1 = I_2$$

$$\Phi_1 = \Phi_2$$

$$\Phi_1 - \Phi_2 = 0$$

Insulation fault

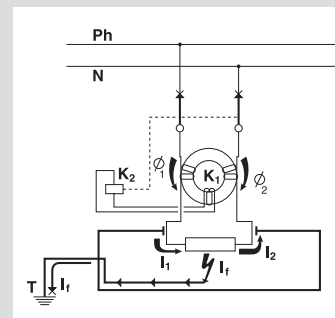


A current is thus induced in coil K₁...

$$I_1 \neq 0$$

$$I_1 > I_2, \text{ thus}$$

$$\Phi_1 > \Phi_2, \text{ thus}$$

$$\Phi_1 - \Phi_2 \neq 0$$

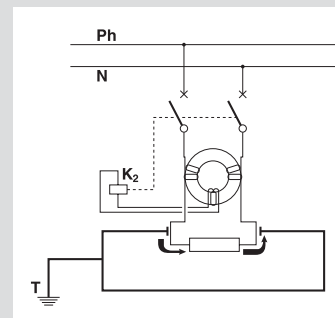

...coil K₂ is excited, the contacts open and the equipment is automatically switched OFF

Selecting a residual current device

First determine your requirement. This exists on two levels :

- 1 The need to protect against direct or indirect contacts.
- 2 The need to ensure protection against overloads and short-circuits.

If protection against indirect contact is required, use residual current devices with a sensitivity of :

- 30 mA,
- 100 mA,
- 300 mA,

The rating (40, 63 A, etc.) is selected according to the load.

If protection against direct contact is required, use residual current device with a sensitivity of 30 mA.

The sensitivity of a residual current device $I\Delta n$ is the current level at which tripping is sure to occur. To do this, the standards concerning residual current devices stipulate that tripping must occur between $I\Delta n / 2$ and $I\Delta n$.

Technical data
Types of residual current device

There are 2 types of RCD : the AC type and the A type


Both types are produced in the "S" (discriminating) or normal versions. They conform to Indian and International standards IS 12640, IEC 61008 and IEC 61009 as well as European standards EN 61008 and EN 61009.

• Type A 

Sensitive to residual alternating currents and residual currents with a DC component.

Use : special applications

- if it is possible that the fault currents are not purely sinusoidal (rectifier bridge, etc.)

• Type AC 

Sensitive to residual alternating currents

Use : standard applications

• Type S 

Delayed trip for discrimination with other residual current devices.

Use : for discrimination with a downstream device.

• Type Hpi 

• Enhanced immunity to unwanted tripping in environments with disturbances. eg. diesels, computers, printers, etc.

• Detects faults with DC components eg. thyristors, trio etc.

Residual current circuit-breaker with or without overload protection? Which do I choose?

Choose a residual current circuit-breaker (RCCB) if you do not need to protect against overload and short circuits (caution! an RCCB must be connected to some form of line protection device : either a circuit-breaker or a fuse).

Choose a residual current circuit-breaker with overload and short circuit protection (RCBO) if this type of protection is not available.

Residual current circuit-breakers without overload and short circuit protection (RCCB)


These provide two functions : fault current detection, measurement and cut-off : and isolation of an installation.

RCCBs are governed by standards IS 12640 (part 1), IEC 61008-1.

Residual current circuit-breakers with overload and short circuit protection (RCBO)


These provide three functions : fault current detection, measurement and cut-off : protection against overloads and short-circuits : and isolation of an installation.

Residual current circuit-breakers are governed by standards IS 12640 (part 2), IEC 61009-1.

The "test" function

A residual current device is a safety device, and it is therefore vital that it is regularly tested. This function is therefore required by the standard governing residual current protective devices, and ensures correct operation. All Lexic RCDs are equipped with this function.

Note : We offer Type AC, Type A-S and Type Hpi RCDs

Compatibility MCBs/add-on modules

| Breaking capacity | Number of poles | Add-on module for 1.5 module/pole MCBs |
|-------------------|-----------------|--|
| 16 kA | 2P, 4P | In ≥ 80 A |
| 25 kA | 4P | In ≥ 32 A |
| | 2P | In ≥ 40 A |
| | 4P | In ≥ 12,5 A |
| 50 kA | 2P | In ≥ 32 A |
| | 2P, 4P | All range |

Operating principle

Temporarily electrical disturbances and other external events can cause unwanted tripping of different devices protecting electrical installation

STOP&GO verifies automatically the state of the installation, before resetting and launches a visual and close a contact in case of permanent fault detection (short-circuit or residual current)

After verifying the state of the installation, STOP&GO automatic resets the associated protection device in order to immediatly re-establish power supply and avoid unwanted consequences

STOP&GO does not protect the installation against lightning strikes
For an efficient protection against lightning, use voltage surge protectors

The Autotest version is specially suitable for installations equipped with residual current protection devices (RCD's and RCBOs)
STOP&GO periodically does an automatic test of the functioning of residual current protection devices. The manual test is no longer needed




Installation without STOP&GO



Installation with STOP&GO

Mains fault due to temporarily electrical disturbances
Electrical devices are not powered anymore


STOP&GO automatic resets the associated protection device in order to immediatly re-establish power supply

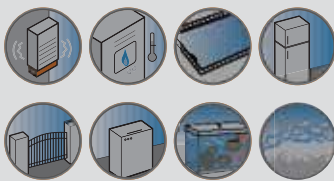

Technical characteristics of auxiliaries

Max. connection cross-section: 2.5 mm²
Operating temperature: - 25 °C to + 70 °C

Shunt trips

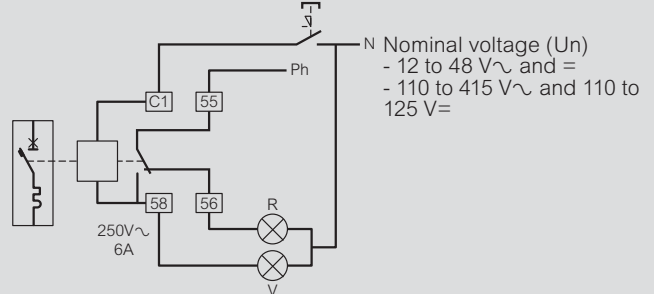

Equipped with a signalling contact which indicates tripping of the shunt trip and automatically breaks the coil.

Min. and max. voltage: 0.7 to 1.1 Un

Tripping time: less than 20 ms

Power consumption: at 1.1 x 48 V = 121 VA
at 1.1 x 415 V = 127 VA

Impedance: 12 to 48 V = 23 Ω
110 to 415 V = 1640 Ω


| Consumption | Umin. | Umax. |
|--------------|--------|---------|
| 12 to 48 V | 522 mA | 2610 mA |
| 110 to 415 V | 69 mA | 259 mA |

Undervoltage releases

Pull-in voltage $\geq 0.55 U_n$

Tripping time: 0 to 300 ms \pm 10% (adjustable)


Power consumption: 24 V \sim and = : 0.1 VA
48 V \sim and = : 0.2 VA
230 V \sim : 1 VA

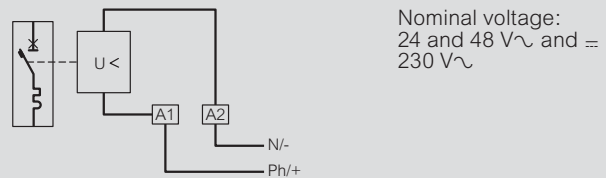

Stand-alone releases for N/C push-buttons

Min. and max. operating voltage: 196 to 250 V \sim

Power consumption: 1.4 VA

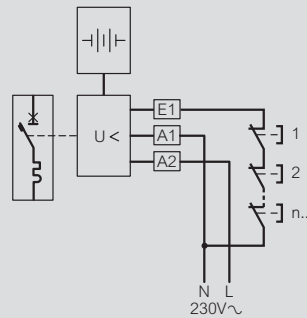


Signalling auxiliaries

Umin.: 24 V \sim / = and Imin.: 5 mA

Electric wiring diagram

Cat.No 4062 86

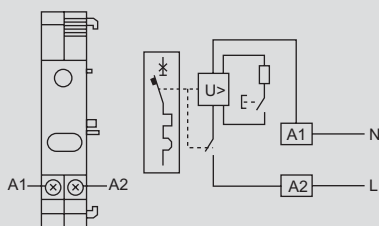

Tripping time:

Limit values of breaking time and non actuation time at a voltage

| | 255 V | 275 V | 300 V | 350 V | 400 V |
|--------------------|-------------|--------|-------|----------|----------|
| Breaking time | No tripping | 15 Sec | 5 Sec | 0.75 Sec | 0.20 Sec |
| Non actuation time | | 3 Sec | 1 Sec | 0.25 Sec | 0.07 Sec |

Combinations with auxiliaries:

| | CA / SD / ET / MT / DA | CM | |
|--|------------------------------------|---------------|------------------|
| | | | |
| | | | 4062 91/93/95 |
| | | | 4062 58/60/62/66 |
| | 4062 58/60/62/76/78/80/82/84/87 | 4062 58/60/62 | 4062 91 |
| | 4062 58/60/62/66/76/78/80/82/84/87 | 4062 66 | |
| | 4062 58/60/62 | 4062 58/60/62 | 4062 93/95 |
| | 4062 58/60/62/66 | 4062 66 | |

Protection of DC circuits

DX³ 6000 and DX³ 10000 MCBs (1P/2P/3P/4P - I_n ≤ 63 A) designed for use in 230/400 V~ supplies, can also be used in DC circuits. In this case, the following deratings and precautions must be taken into account:

1 - Protection against short-circuits

Max. magnetic tripping threshold: multiplied by 1.4


Example: For a C curve MCB for which the AC tripping threshold is between 5 and 10 I_n, the DC tripping threshold will be between 7 and 14 I_n

2 - Protection against overloads

The time/current thermal tripping curve is the same as for AC

3 - Operating voltage

Max. operating voltage: 80 V per pole (60 V for single-pole + N MCBs). For voltages higher than this value, several poles must be wired in series.




Example: for a 110 V voltage, use a 2-pole MCB and connect the 2 poles in series

4 - Breaking capacity

4000 A for a single pole MCB at max. voltage (80 V~ per pole)

For other voltages, the breaking capacities are as follows:

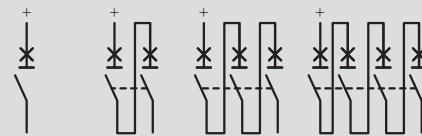

| DX ³ 6000 | voltage | single-pole | 2P | 3P | 4P | |
|----------------------|--------------------|-------------|-------|-------|-------|-------|
| Acc. to IEC 60947.2 | Icu | ≤ 48 V | 6 kA | 6 kA | | |
| | | 110 V | | 6 kA | 6 kA | |
| | | 230 V | | | | 10 kA |
| | Ics ⁽¹⁾ | ≤ 48 V | 100 % | 100 % | | |
| | | 110 V | | 100 % | 100 % | |
| | | 230 V | | | | 100 % |

| DX ³ 10000 | voltage | single-pole | 2P | 3P | 4P | |
|-----------------------|--------------------|-------------|-------|-------|-------|-------|
| Acc. to IEC 60947.2 | Icu | ≤ 48 V | 10 kA | 10 kA | | |
| | | 110 V | | 10 kA | 10 kA | |
| | | 230 V | | | | 15 kA |
| | Ics ⁽¹⁾ | ≤ 48 V | 100 % | 100 % | | |
| | | 110 V | | 100 % | 100 % | |
| | | 230 V | | | | 100 % |


1: As a % of Icu

5 - Distribution of breaking poles

To choose the MCB and determine the pole distribution necessary for breaking on each of the polarities, it is necessary to know how the installation is earthed.

• Supply with one polarity earthed:

Place all the poles necessary for breaking on the other polarity. If isolation is required, an additional pole must be added on the earthed polarity.



1: Only if isolation required

Protection of DC circuits


Protection of DC circuits

Example: circuit earthed via the negative polarity / $U = 110\text{ V}_{\text{DC}}$ / $I_{\text{sc}} = 10\text{ kA}$ / $I_n = 32\text{ A}$

Protect the positive polarity using an MCB capable of breaking 10 kA at 110 V (DX³ 10000 2P 32 A with 2 poles on the positive polarity)


For isolation, use a DX³ 10000 3P 32 A with 2 poles on the positive polarity and one pole on the negative polarity

| DX ³ 10000 | voltage | single-pole | 2P | 3P | 4P |
|-----------------------|--------------------|-------------|-------|-------|-------|
| Acc. to | $\leq 48\text{ V}$ | 10 kA | 10 kA | | |
| IEC 60947.2 Icu | 110 V | | 10 kA | 10 kA | |
| | 230 V | | | | 15 kA |

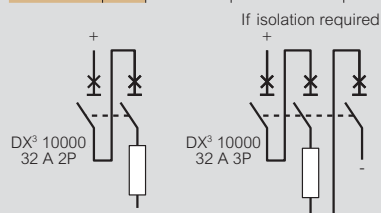

• Network earthed via a middle point:

Place on each polarity the number of poles necessary for max. I_{sc} breaking at half voltage

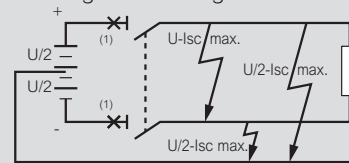


1: MCB ($U/2-I_{\text{sc}} \text{ max.}$)

Example: circuit earthed via a middle point / $U = 230\text{ V}_{\text{DC}}$ / $I_{\text{sc}} = 6\text{ kA}$ / $I_n = 10\text{ A}$


Protect each polarity using an MCB capable of breaking 6 kA at half voltage, i.e. 115 V

| DX ³ 6000 | voltage | single-pole | 2P | 3P | 4P |
|----------------------|--------------------|-------------|------|------|-------|
| Acc. to | $\leq 48\text{ V}$ | 6 kA | 6 kA | | |
| IEC 60947.2 Icu | 110 V | | 6 kA | 6 kA | |
| | 230 V | | | | 10 kA |



• Isolated earth supply:

Distribute the poles necessary for breaking over the 2 polarities to provide protection in the event of a double earth fault (particularly if there are a number of circuits in parallel)

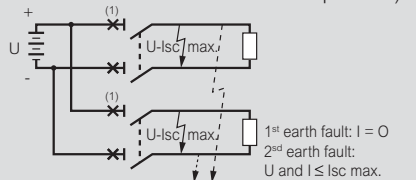


1: MCB ($U-I_{\text{sc}} \text{ max.}$)

Example: isolated earth circuit / $U = 48\text{ V}_{\text{DC}}$ / $I_{\text{sc}} = 4,5\text{ kA}$ / $I_n = 40\text{ A}$

Protect the installation with an MCB capable of breaking 4.5 kA at 48 V and protect each polarity

| DX ³ 6000 | voltage | single-pole | 2P | 3P | 4P |
|----------------------|--------------------|-------------|------|------|-------|
| Acc. to | $\leq 48\text{ V}$ | 6 kA | 6 kA | | |
| IEC 60947.2 Icu | 110 V | | 6 kA | 6 kA | |
| | 230 V | | | | 10 kA |




Programmable time switches


with analogue and digital dial

Diagrams


Cat.No 4126 31




Cat.Nos 4126 54/34/29




Cat.Nos 4126 57/41/30



Cat.Nos 4127 90/94

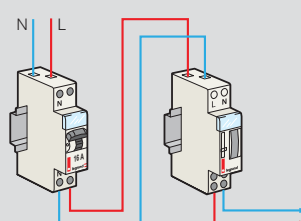

Cat.Nos 4128 12/13/14

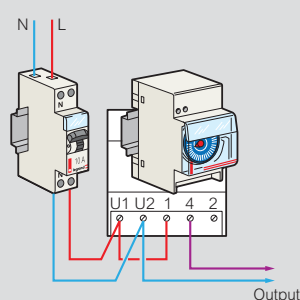

Output closing and breaking times are calculated based on the date, the actual time when the device was switched and on geographical coordinates of the actual location

AlphaRex³ digital time switches

Technical specifications


| Type | AlphaRex ³ D21 | AlphaRex ³ D22 | AlphaRex ³ D21s | AlphaRex ³ D21 astro | AlphaRex ³ D22 astro | AlphaRex ³ DY21 | AlphaRex ³ DY22 |
|--|---------------------------|---------------------------|----------------------------|---------------------------------|---------------------------------|----------------------------|----------------------------|
| Nominal voltage 230 V 50/60 Hz | 4126 31 | 4126 41 | 4126 34 | 4126 54 | 4126 57 | 4126 29 | 4126 30 |
| Number of modules of 17.5 mm each | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| Number of channels | 1 | 2 | 1 | 1 | 2 | 1 | 2 |
| Switch output | 1 changeover contact | 2 changeover contacts | 1 changeover contact | 1 changeover contact | 2 changeover contacts | 1 changeover contact | 2 changeover contacts |
| Zero-crossing switching | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Switching capacity | | | | | | | |
| • Ohmic 250 V \sim $\cos \phi = 1$ | 16 A \sim | 16 A \sim | 16 A \sim | 16 A \sim | 16 A \sim | 16 A \sim | 16 A \sim |
| • Inductive 230 V \sim $\cos \phi = 0.6$ | 10 A \sim | 10 A \sim | 10 A \sim | 10 A \sim | 10 A \sim | 10 A \sim | 10 A \sim |
| • Incandescent lamp load | 2000 W | 2000 W | 2000 W | 2000 W | 2000 W | 2000 W | 2000 W |
| • Fluorescent lamp, series compensated | 2000 VA | 2000 VA | 2000 VA | 2000 VA | 2000 VA | 2000 VA | 2000 VA |
| • Energy-saving lamp | 1000 W | 1000 W | 1000 W | 1000 W | 1000 W | 1000 W | 1000 W |
| Programs ¹⁾ | 56 | 28 per channel | 56 | 56 | 28 per channel | 84 | 84 per channel |
| Control input with switch-off delay 0 s to 23 h 59 min 59 s | | | ✓ | ✓ | | ✓ | |
| Cycle function (pulse time) min. 1 s, max. 1 h 59 min 59 s | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Clock precision (typical) | | | | | ~ 0.1 s/day ²⁾ | | |
| Running reserve | | | | | 5 years | | |
| Shortest switching step | | | | | 1 s | | |
| Operating temperature | | | | | -20 to +55 °C | | |
| Degree of protection | | | | | IP20 | | |

¹⁾ A program consists of a switch-on time, a switch-off time as well as days or day blocks which are assigned as "switched-on" or "switched-off"


²⁾ Can be set to mains-synchronous operation

Connection diagram


AlphaRex³ D21



AlphaRex³ D22
AlphaRex³ D22 astro
AlphaRex³ DY22



AlphaRex³ D21s
AlphaRex³ D21 astro
AlphaRex³ DY21



Functions

- Select menu, go back while in menu
Press > 1 sec. = operating display
- Confirm the selection or accept the parameter
- Select the menu item or set the parameter;
for 2-channel time switches, can be used
to select the channel (channel 1 – channel 2)
-

Brief description of programming functions

Text guidance

Guides the user through programming and setup with plain text prompts. Each step can be read on the screen, and the function that is currently active flashes. An integrated display and button light makes operation easy even in poorly lit environments.

Set language

The language selection function can be accessed using the "MENU" button. The language is set to English by default. The following languages can be selected: German, English, French, Italian, Spanish, Dutch, Portuguese*, Swedish*, Norwegian*, Finnish*, Danish*, Polish*, Czech*, Russian*, Turkish*.

* Excluding AstroRex DY64

Time, date, summer time (daylight saving time)

The time switch is preset at the factory to the current time and date. The time can be changed by selecting "MENU" + "SET".

Reset

Simultaneously pressing all buttons for more than 2 seconds deletes all data. Language, date/time, summer time (daylight saving time) and switch times must be set again.

Data key

If the supply voltage is switched on, the "KEY – READ – WRITE" menu item is automatically opened when a data key is inserted. "WRITE": Program data is written from the time switch to the key. Caution: Any data present on the key will be overwritten. "READ": Program data is written from the key to the time switch; any switching programs on the time switch are overwritten. Only one master switching program, which consists of multiple switching programs, can be saved on the time switch or on the key at a time. If the supply voltage is not connected, the "KEY – READ – WRITE" menu item is not automatically opened when a data key is inserted. The "KEY" function can still be selected from the menu even if the supply voltage is not connected.

PC programming

In addition to the easy, text-guided programming directly on the time switch, switching programs can also be created on a PC with the software program from Legrand and transferred to the time switch using a data key. A data transfer device (Cat.No : 4128 73) is required to transfer switching programs created on a PC to the data key. The device is connected to the PC using the USB plug. In addition to the data transfer device, we also offer a CD with the software and the necessary drivers. PC system requirements: USB port; Windows[®] XP, Windows[®] Vista, Windows[®] 7; approx. 40 MB of free memory.

Brief description of programming functions

Weekly programs

To create a weekly program, select "MENU", "PROGRAM", and then "CREATE" to easily enter programs which are repeated on a weekly basis. A weekly program consists of a switch-on/switch-off times and days which are assigned as "switched-on" or "switched-off". The following predefined blocks can be selected: "MONDAY – SUNDAY", "MONDAY – FRIDAY"¹⁾ or "SATURDAY – SUNDAY"¹⁾; the assigned days of the week are fixed. The switch-on/switch-off times must be entered. The user can also set custom day blocks. By selecting "CUSTOM", switch times can be freely assigned to any days of the week. This option also allows the user to set switch times at midnight.

¹⁾Excluding AlphaRex³ DY, AstroRex DY64

Yearly programs [AlphaRex³ DY21, AlphaRex³ DY22]

This menu item allows the user to enter (additional) yearly programs, which are only executed within a defined validity period. They can overlap with one another and with the weekly programs on the same channel based on an "OR" connective. The validity period is defined by entering the start date (at 00:00:00) and the end date (at 24:00:00). The start date must be entered before the end date. With the "EVERY YEAR" option, the additional switch times have the same validity period each year (Christmas, national holidays, birthdays, etc.) Select the "ONCE" option when additional switch times are needed within a validity period (e.g. during holidays), but the start/end dates of the holiday period change from year to year.

Special programs (priority program) [AlphaRex³ DY21, AlphaRex³ DY22]

Weekly and yearly programs on the same channel are not executed during the validity period of a special program. However, other special programs can be executed during the validity period. Different special programs can overlap with each other based on an "OR" connective. With the "EVERY YEAR" option, the additional switch times have the same validity period each year (Christmas, national holidays, birthdays, etc.). Select the "ONCE" option when additional switch times are needed within a validity period (e.g. during holidays), but the start/end dates of the holiday period change from year to year. Additional options include "MON TO SUN"/"CUSTOM": the respective channel only switches according to the special program; "PROG ON"/"PROG OFF": the respective channel is switched on/off during this time period.

Basic functions for "astro"

Location (astro) [AlphaRex³ D21 astro, AlphaRex³ D22 astro, AlphaRex³ DY21, AlphaRex³ DY22]


The sunrise/sunset times, which change daily, are calculated for the location programmed in the AlphaRex. The unit is delivered with the location set to "GERMANY – SOEST" by default. Enter the actual location for optimal operation. This can be done in two ways. Select "MENU", "SET" and "ASTRO" to access the two options "LOCATION" and "COORDINATES". "LOCATION": With this menu item, the user can select the country and city which is closest to the site of operation. "COORDINATES": Alternatively, the user can select this menu item to set the geographical coordinates of the location. The longitude and latitude values are entered in degrees or degrees and arcminutes²⁾ (precision can be set in expert mode). Information on coordinates and time zones can be found in the time zone map included with every time switch.

Offset

By selecting "MENU", "SET", "ASTRO" and "OFFSET", time differentials can be set for the calculated switch times. This can be done in two ways: time offset or angle offset.

In time offset, a time differential can be entered to shift the switch time by up to +/- 120 min relative to the sunrise/sunset times.


In angle offset²⁾, a value can be entered in degrees and arcminutes to shift the switch time by up to +/- 12° 00' relative to the sunrise/sunset times. The time differentials are set separately for sunrise and sunset using the menu items "SUNSET" (opens the screen for setting the sunset offset) and "SUNRISE" (opens the screen for setting the sunrise offset).

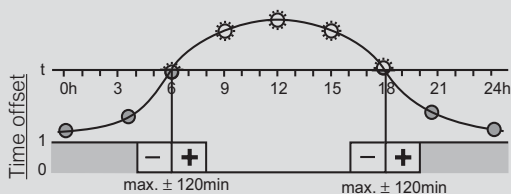

Example:

For a time differential of +30 min, the time switch switches 30 min. after sunrise and 30 min. after sunset.

For a time differential of -30 min, the time switch switches 30 min. before sunrise and 30 min. before sunset.

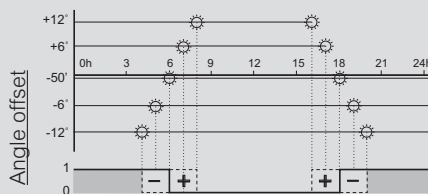

Note:

If the offset is set in degrees, the time switch always switches at points when the brightness is the same, despite the fact that the twilight duration changes over the course of the year. Sunrise and sunset correspond to -50' for the centre of the sun (the edge of the sun is visible on the horizon).

Offset correction function²⁾

Select "MENU", "SET", "ASTRO" and "CORRECTION" to set a time correction for the 6-month periods surrounding summer and winter. The time correction is set to 0 min. by default and can be set from 1 min. up to 30 min. The time correction for sunset is entered in the "SUNSET" menu item. The time correction for sunrise is set in the "SUNRISE" menu item. The correction function overlaps with the calculated astronomical switch times, including the offset settings.

Example:

Setting a time correction extends the daily switched-on time by up to 60 min. in the middle of the six winter months (switches off up to 30 min. later in the morning and switches on up to 30 min. earlier in the evening). In the middle of the six summer months, the time correction reduces the daily switched-on time by up to 60 min. (switches off up to 30 min. earlier in the morning and switches on up to 30 min. later in the evening). The time correction varies continuously between the two max. values during the rest of the year.

Basic settings using a PC and day key

All of the basic settings described above, with the exception of the current time and date, can be set up using the AlphaSoft software from Legrand and imported to the time switch using the data key.²⁾ Excluding AstroRex DY64

AlphaRex³ digital time switches

Additional functions

Relay function

The relay state can be changed by selecting "MENU" and "FUNCTIONS". The relay is preset to the "AUTO" function; the time switch switches at the programmed times. The following can also be selected: "ALWAYS ON", "ALWAYS OFF" and "EXTRA". If "EXTRA" is selected, the switching status specified by the program is inverted. The time switch resumes switching according to the programmed switch times after the next switch command.

Holiday program

In holiday program, the holiday period is set with a start and an end date. It can be activated with the "ACTIVE" program item and deactivated with "PASSIVE". If the holiday program is activated, the time switch does not carry out any programmed switch commands during this time period. Instead, it remains "ALWAYS OFF" or "ALWAYS ON" during the holiday period, as requested. When the holiday period has ended, the time switch resumes switching according to the programmed switch times.

1 h test

The "1 h TEST" function can be used for a switching simulation. If "1 h TEST" is activated, the switch outputs are switched for one hour. After the time has ended, the time switch resumes switching according to the programmed switch times.

PIN code

Input and programming can be locked using a four-digit "PIN CODE". The time switch can be unlocked using the "PIN CODE". The time switch can also be unlocked using the "RESET" function, which also deletes all settings and programs.

Operating hours counter

This function displays the time for which the relay has been switched on and the date of the last reset. Counting range: 65,535 h.

Contrast adjustment

This function allows the user to adjust the display contrast.

Expert mode*

Expert mode is activated by selecting "OPTIONS" and "EXPERT". After expert mode is activated, the following additional functions can be used: control input "extra"¹⁾, control input "out"¹⁾, cycle function, channel-switching function (2-channel time switches), mains-synchronous operation, offset correction function²⁾, geographical coordinates in degrees and arcminutes²⁾.

¹⁾ AlphaRex³ D21s, AlphaRex³ D21 astro, AlphaRex³ DY21 ²⁾ AlphaRex³ astro, AlphaRex³ DY

Control input with switch-off delay

Adjustable switch-off delay via control input. The control input enables an additional switching of the relay, parallel to the switching program. The switch-off delay can be set from 0 s to 23 h 59 min 59 s. The switch-off delay begins as soon as the voltage is removed from the control input.

Control input "extra"*

Override of switching state via control input. If the "EXTRA" function is activated, the switching state specified by the program is inverted. The time switch resumes switching according to the programmed switch times after the next switch command. The "EXTRA" function is ended prematurely if the button is pressed again or if a pulse is received at the control input.

Control input "off"*

Switch off via control input. Activating the "OFF" function causes the time switch to be switched off via the control input. The "OFF" function is ended if the button is pressed again or if a pulse is received at the control input. The time switch resumes switching on/off according to the programmed switch times.


Pulse function

Programmable with precision to the second.

Cycle function

Function for cyclical switching. With this function, the time switch is switched on once within a defined time period and for a defined duration. The cycle time can be set between 2 s and 2 h. The switch-on time can be set between 1 s and 1 h 59 min 59 s.

| | Min. | Max. |
|----------------|------|-----------------|
| Cycle | 2 s | 2 h |
| Switch-on time | 1 s | 1 h 59 min 59 s |

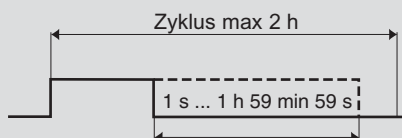

Random function

If the random function is activated, set switch times are randomly shifted within a range of +/- 15 minutes.

Channel-switching function*

With 2-channel time switches, this function can be activated so that the time switch regularly switches between the outputs assigned to the channels, in order to protect connected devices (for example lights/lamps) or so that two devices can be used simultaneously. The channel-switching function is activated by selecting "MENU", "OPTIONS" and "CHANNEL 1<>2". The time switch switches between the outputs according to whether the menu item "DAILY" (once per day at 12:00 p.m.) or "WEEKLY" (once per week on Sunday at 12:00 p.m.) is selected.

Mains-synchronous operation

Mains-synchronised clock precision. By activating the "SYNC" function and then "ACTIVE", the quartz-controlled time switch becomes a synchronous time switch.


*) Excluding AstroRex DY64

Technical specifications


| Type | MicroRex T31 | MicroRex QT31 | MicroRex W31 | MicroRex QT11 | MicroRex QW11 |
|-----------------------------------|----------------------|----------------------|----------------------|-------------------------|-------------------------|
| Number of modules of 17.5 mm each | 3 | 1 | | | |
| Number of channels | 1 | 1 | 1 | 1 | 1 |
| Drive type | synchronous | quartz | synchronous | quartz | quartz |
| Switching dial | 24 h | 24 h | 7 days | 24 h | 7 days |
| Running reserve | none | 100 h | none | 100 h | 100 h |
| Switching increment | 15 min | 15 min | 2 h | 15 min | 2 h |
| Shortest switching step | 30 min | 30 min | 4 h | 15 min | 2 h |
| Switching step | +/- 5 min | +/- 5 min | +/- 30 min | +/- 5 min | +/- 30 min |
| Clock precision | mains | 2.5 s/day | mains | 2.5 s/day | 2.5 s/day |
| Switching capacity | | | | | |
| • Ohmic 230 V~ cos φ = 1 | 16 A~ | | | | |
| • Incandescent lamp 230 V~ | 4 A~ | | | | |
| • Inductive 230 V~ cos φ = 0.6 | 12 A~ | | | | |
| Switch output | 1 changeover contact | 1 changeover contact | 1 changeover contact | 1 normally open contact | 1 normally open contact |
| Operating temperature | -10 to +55 °C | | | | |
| Degree of protection | IP20 | | | | |

Connection diagram


MicroRex – 3 modules

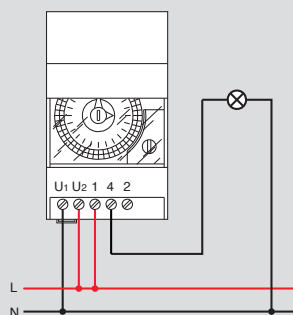

MicroRex – 1 module

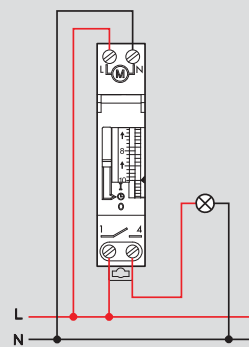

Wall bracket – 3 modules

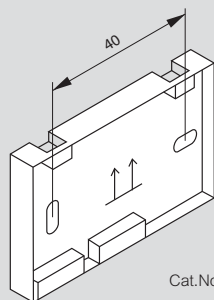


Cat.No 4128 59

3-module MicroRex units can be surface mounted using the wall bracket. A terminal cover is included with delivery.

Standard light sensitive switch (Cat.No 4126 23)

Switch "ON" and "OFF" defined by a light level threshold

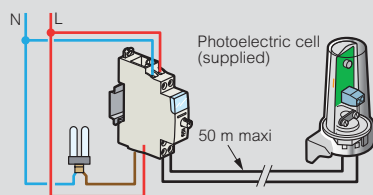

CX³ Changeover switches

Power dissipation per role : 1.5 w
 Overvoltage category : 4 kV~
 Dielectric withstand : 2 kV~
 Degree of pollution : 2

CX³ Push-buttons and control switches

Electrical endurance : 30.000 cycles AC12
 (cos φ = 0.9) IEC 60947-5-1
 Electrical endurance under fluorescent loads : 30 000 cycles according to IEC 60669-1

CX³ LED indicators

Equipped with non replaceable LED lamps
 LED life : 100 000 h.
 LED consumption :
 - 0.17 W under 230 V~
 - 0.11 W under 24 V~

Power contactors CX³

■ Technical characteristics

- Rated impulse withstand voltage (Uimp): 4 kV
- Mechanical endurance (no. of operating cycles): 10⁶ cycles
- Operating temperatures: - 25 °C to + 40 °C
- Storage temperatures: - 40 °C to + 70 °C

Contactor protection against short circuits according to standard EN 61095, conditional short-circuit current:

- I_q = 6 kA for 16 to 25 A contactors

- I_q = 3 kA for 40 to 63 A contactors

Circuit breaker or gG fuse rated:

- ≤ 16 A for 16 A rating • ≤ 40 A for 40 A rating
- ≤ 25 A for 25 A rating • ≤ 63 A for 63 A rating

• Consumption of a contactor control coil

| 16 A and 25 A power contactors | | | | | |
|--------------------------------|-----------------|---------------|---------------------|-------------------------|-----------------------------|
| Coil voltage | 24 V~ | | 230 V~ low noise | 230 V~ | |
| | Current | 16 A and 25 A | 25 A | 25 A | 16 A and 25 A |
| Type of contact | NC + NO 2 NO | 4 NO | 2 NO | NC + NO 2 NO 2 NC | 2 NC + 2 NO 4 NO 4 NC |
| Dimensions | 1 mod. | 2 mod. | 1 mod. | 1 mod. | 2 mod. |
| Holding current | 200 mA | 300 mA | 12 mA | 20 mA | 20 mA |
| Inrush current | 970 mA | 2500 mA | 60 mA | 90 mA | 200 mA |

| 40 A and 63 A power contactors | | | | |
|--------------------------------|---------|---------------|---------------|----------------------|
| Coil voltage | 24 V~ | | 230 V~ | |
| | Current | 40 A and 63 A | 40 A and 63 A | 40 A and 63 A |
| Type of contact | 2 NO | 4 NO | 2 NO 2 NC | 3 NO 4 NO 4 NC |
| Dimensions | 2 mod. | 3 mod. | 2 mod. | 3 mod. |
| Holding current | 250 mA | 270 mA | 15 mA | 30 mA |
| Inrush current | 1750 mA | 1500 mA | 150 mA | 200 mA |

• Recommendations

Insert a spacing module (Cat.No 4063 07 p. 40):

- every two contactors when the ambient temperature is below 40 °C
- every contactor when the ambient temperature is between 40 and 60 °C

| Contactor rating | 40 °C | 50 °C | 60 °C |
|------------------|-------|-------|-------|
| le = 16 A | 16 A | 14 A | 12 A |
| le = 25 A | 25 A | 22 A | 20 A |
| le = 40 A | 40 A | 36 A | 32 A |
| le = 63 A | 63 A | 57 A | 50 A |

• Max. connection cross-section in mm²

| Conductor type | Ratings ≤ 25 A | Ratings 40 & 63 A |
|------------------------------|--|--|
| Rigid | 6 ² or 2 x 2.5 ² | 25 ² or 2 x 10 ² |
| Flexible | 6 ² or 2 x 2.5 ² | 25 ² or 2 x 10 ² |
| Flexible with single end cap | 6 ² | 16 ² |
| Flexible with double end cap | 2 x 4 ² | 2 x 16 ² |

■ Contactor selection charts

• Incandescent lamps

| Tungsten and halogen filaments 230 V~ | | | | | | | | |
|---------------------------------------|------|------|------|-------|-------|-------|-------|--------|
| Nominal wattage | 40 W | 60 W | 75 W | 100 W | 150 W | 200 W | 500 W | 1000 W |
| 16 A | 45 | 30 | 24 | 19 | 13 | 10 | 4 | 2 |
| 25 A | 60 | 48 | 38 | 30 | 20 | 15 | 6 | 3 |
| 40 A | 96 | 77 | 61 | 48 | 32 | 24 | 10 | 5 |
| 63 A | 154 | 123 | 97 | 77 | 51 | 38 | 15 | 8 |

| ELV halogen bulbs with ferromagnetic ballast | | | | | | ELV halogen bulbs with electronic ballast | | | | | | |
|--|------|------|------|------|-------|---|------|------|------|------|-------|-------|
| Nominal wattage | 20 W | 35 W | 50 W | 75 W | 100 W | 150 W | 20 W | 35 W | 50 W | 75 W | 100 W | 150 W |
| 16 A | 32 | 20 | 15 | 12 | 9 | 6 | 60 | 40 | 28 | 18 | 14 | 9 |
| 25 A | 52 | 30 | 24 | 16 | 12 | 8 | 80 | 50 | 40 | 26 | 20 | 13 |
| 40 A | 68 | 39 | 31 | 21 | 16 | 10 | 112 | 70 | 56 | 36 | 28 | 18 |
| 63 A | 88 | 51 | 41 | 27 | 20 | 14 | 157 | 98 | 78 | 51 | 39 | 25 |

■ Contactor selection charts (continued)

• Fluorescent tubes with ferromagnetic ballast

| Nominal wattage | Single parallel compensated fluorescent | | | | | Double series compensated fluorescent | | | | |
|-----------------|---|------|------|------|-------|---------------------------------------|----------|----------|----------|-----------|
| | 18 W | 20 W | 36 W | 58 W | 115 W | 2 x 20 W | 2 x 36 W | 2 x 40 W | 2 x 58 W | 2 x 140 W |
| 16 A | 24 | 24 | 16 | 11 | 5 | 30 | 24 | 22 | 15 | 6 |
| 25 A | 33 | 30 | 25 | 17 | 9 | 45 | 38 | 35 | 24 | 10 |
| 40 A | 43 | 39 | 33 | 22 | 12 | 68 | 57 | 53 | 36 | 15 |
| 63 A | 56 | 51 | 42 | 29 | 15 | 101 | 86 | 79 | 54 | 23 |

| Nominal wattage | Quadruple series compensated fluorescent | | | | Compact fluorescent with built-in starter | | | |
|-----------------|--|--|--|--|---|------|------|------|
| | 4 x 18 W | | | | 7 W | 10 W | 18 W | 26 W |
| 16 A | 16 | | | | 50 | 40 | 28 | 19 |
| 25 A | 24 | | | | 60 | 50 | 42 | 28 |
| 40 A | 36 | | | | 78 | 65 | 55 | 36 |
| 63 A | 54 | | | | 101 | 85 | 71 | 47 |

• Fluorescent tubes with electronic ballast

| Nominal wattage | Single fluorescent | | | | Double fluorescent | | |
|-----------------|--------------------|------|------|------|--------------------|----------|----------|
| | 18 W | 30 W | 36 W | 58 W | 2 x 18 W | 2 x 36 W | 2 x 58 W |
| 16 A | 72 | 42 | 36 | 22 | 36 | 20 | 12 |
| 25 A | 110 | 68 | 58 | 36 | 56 | 30 | 19 |
| 40 A | 165 | 102 | 87 | 54 | 84 | 45 | 29 |
| 63 A | 248 | 153 | 131 | 81 | 126 | 68 | 43 |

| Nominal wattage | Triple fluorescent (series compensated) | | | Quadruple fluorescent (series compensated) | |
|-----------------|---|----------|----------|--|--|
| | 3 x 14 W | 3 x 18 W | 4 x 14 W | 4 x 18 W | |
| 16 A | 34 | 26 | 26 | 20 | |
| 25 A | 46 | 38 | 37 | 28 | |
| 40 A | 62 | 51 | 52 | 39 | |
| 63 A | 84 | 69 | 73 | 55 | |

| Compact fluorescent with built-in electronic power supply | | | | | |
|---|-----|------|------|------|------|
| Nominal wattage | 7 W | 11 W | 15 W | 20 W | 23 W |
| 16 A | 120 | 80 | 64 | 50 | 43 |
| 25 A | 200 | 125 | 90 | 70 | 60 |
| 40 A | 280 | 175 | 126 | 98 | 84 |
| 63 A | 392 | 245 | 176 | 137 | 118 |

• Discharge lamps with compensation

| Nominal wattage | Metal halogenide | | | | | | Low pressure sodium vapour | | | | | |
|-----------------|------------------|------|-------|-------|-------|-------|----------------------------|------|------|------|-------|-------|
| | 35 W | 70 W | 100 W | 150 W | 250 W | 400 W | 18 W | 35 W | 55 W | 90 W | 135 W | 180 W |
| 16 A | 10 | 6 | 5 | 3 | 2 | 1 | 12 | 6 | 5 | 3 | 2 | 2 |
| 25 A | 15 | 9 | 7 | 5 | 3 | 2 | 20 | 10 | 7 | 5 | 3 | 3 |
| 40 A | 23 | 14 | 11 | 8 | 5 | 3 | 30 | 15 | 11 | 8 | 5 | 5 |
| 63 A | 34 | 20 | 16 | 11 | 7 | 5 | 45 | 23 | 16 | 11 | 7 | 7 |

| Nominal wattage | High pressure sodium vapour | | | | | High pressure mercury vapour | | | | |
|-----------------|-----------------------------|-------|-------|-------|--------|------------------------------|------|-------|-------|-------|
| | 70 W | 150 W | 250 W | 400 W | 1000 W | 50 W | 80 W | 125 W | 250 W | 400 W |
| 16 A | 8 | 7 | 5 | 3 | 1 | 11 | 8 | 6 | 3 | 2 |
| 25 A | 10 | 9 | 6 | 4 | 2 | 15 | 10 | 8 | 4 | 3 |
| 40 A | 15 | 14 | 9 | 6 | 3 | 21 | 14 | 11 | 6 | 4 |
| 63 A | 23 | 20 | 14 | 9 | 5 | 29 | 20 | 16 | 8 | 6 |

| Nominal wattage | High pressure mixed | | | |
|-----------------|---------------------|-------|-------|-------|
| | 100 W | 160 W | 250 W | 400 W |
| 16 A | 9 | 6 | 4 | 2 |
| 25 A | 11 | 7 | 5 | 3 |
| 40 A | 14 | 9 | 7 | 4 |
| 63 A | 19 | 12 | 8 | 5 |

EMDX³ electrical energy meters

└ rail mounting

Technical characteristics

Single-phase meters Cat.Nos 0046 70/77

LCD display: 7 digits
 Resolution: 0.1 kWh
 Maximum indication: 99999.9 kWh
 Metrological LED: 1 Wh/pulse (Cat.No 0046 70 : 0.5 Wh/pulse)
 Accuracy (EN 62053-21): class 1
 Reference voltage Un: 230 V-240 V
 Reference frequency: 50-60 Hz
 Pulse output: 1 pulse/10 Wh
 (Cat.No 0046 70: 2 pulse/Wh)


Three-phase meters Cat.Nos 0046 80/84

LCD display: 8 digits
 Resolution: 0.01 kWh⁽¹⁾
 Maximum indication: 99999.99 kWh⁽¹⁾
 Metrological LED: 0.1 Wh/pulse or 1 Wh/pulse
 Active energy accuracy (EN 62053-21): class 1
 Reactive energy accuracy (EN 62053-23): class 2
 Reference voltage Un:
 - Single-phase: 230-240 V
 - Three-phase: 230(400)-240(415) V
 Operating limit range (EN 62053-21, EN 62053-23):
 - Single-phase: 110 to 254 V
 - Three-phase: 110(190) to 254(440) V
 Pulse output: 1 pulse/10 Wh

| Cat.Nos | | 0046 70 | 0046 77 | 0046 80 | 0046 84 |
|---------------------------------|--|---------------|---------------|------------------|------------------|
| Number of modules | | 1 | 2 | 4 | 4 |
| Connection | Direct | ● | ● | ● | |
| | Via a current transformer | | | | ● |
| | Single-phase | ● | ● | | ● |
| | Three-phase | | | ● | ● |
| Max. current | | 32 A | 63 A | 63 A | 5 A (CT) |
| Metering and measurement | Total active energy | ● | ● | ● | ● |
| | Total reactive energy | | | ● | ● |
| | Partial active energy (reset) | | ● | ● | ● |
| | Partial reactive energy (reset) | | | ● | ● |
| | Active power | | ● | ● | ● |
| | Reactive power | | | ● | ● |
| | Apparent power | | | ● | ● |
| | Current | | ● | ● | ● |
| | Voltage | | ● | ● | ● |
| | Frequency | | ● | ● | ● |
| | Power factor | | ● | ● | ● |
| | Time-of-use | | | ● | |
| | Average active power | | | ● | ● |
| | Max. average active power value | | | ● | ● |
| Communication | Pulse output | ● | | | ● |
| | RS 485 interface | | ● | ● | ● |
| MID compliant | | | | | |
| Operating conditions | Reference temperature | 23 °C ± 2 °C | | | |
| | Operating temperature | -20 to +55 °C | -10 to +45 °C | -5 to +55 °C | |
| | Storage temperature | -40 to +70 °C | -25 to +70 °C | -25 to +70 °C | |
| | Consumption | ≤ 8 VA | | ≤ 4 VA per phase | ≤ 1 VA per phase |
| | Heat dissipation | ≤ 6.5 W | | ≤ 6 W | ≤ 4 W |

Interfacing with IP communication network

RS 485 electricity meters

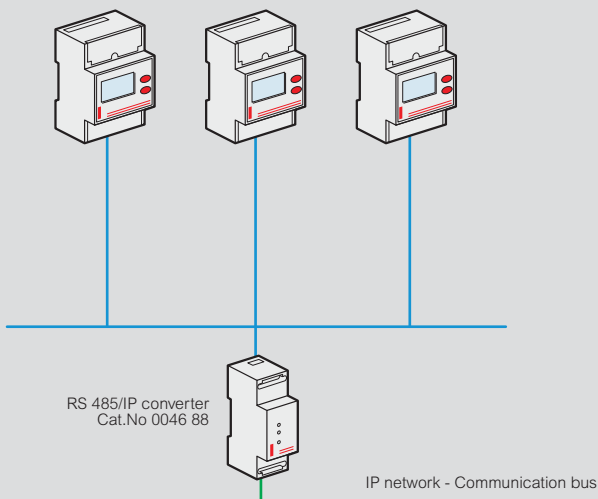

1: For direct connection meters
 If connected via transformers, the resolution and maximum indication depend on the transformation ratios of these transformers


EMDX³ multi-function measuring units

Technical characteristics


| | | | |
|------------------------|-----------------------------------|-------------------------------|--------------------|
| Cat.Nos | | 0046 76 | |
| Connection | Current measurement terminals | 4 mm ² | |
| | Other terminals | 2.5 mm ² | |
| Protection index | Front cover | IP 51 | |
| | Casing | IP 20 | |
| Weight | 205/215 g | | |
| Display | Backlit LCD | | |
| Measurements | 3P+N, 3P, 2P, 1P+N | | |
| Voltage measurement | Direct | Phase/phase | 50 to 520 V \sim |
| | | Phase/neutral | 28 to 300 V \sim |
| | From a PT | Primary | - |
| | | Secondary | - |
| | Permanent overload between phases | 760 V \sim | |
| Update period | 1 s | | |
| Current measurement | From a CT | Primary | 5 to 9999 A |
| | | Secondary | 5 A |
| | Minimum measurement | 5 mA | |
| | Input consumption | < 0.6 VA | |
| | Display | 0 to 9999 A | |
| Power measurement | Total | 0 to 9999 kW/kvar/kVA | |
| | Update period | 1 s | |
| | Frequency measurement | Measurement range | 45.0 to 65.0 Hz |
| | Update period | 1 s | |
| | 50/60 Hz | 200 to 277 V \sim \pm 15% | |
| Auxiliary power supply | DC | - | |
| | Consumption | < 5 VA | |
| Operating temperature | -10 °C to +55 °C | | |
| Storage temperature | -20 °C to +70 °C | | |

Connection solutions


Unbalanced three-phase network (3 or 4-wire)

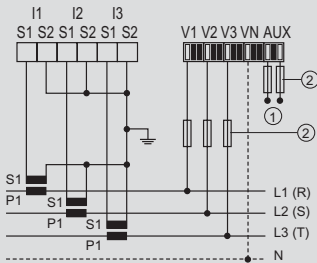


(3-wire)

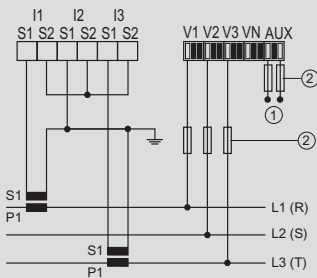


Balanced three-phase network (3 or 4-wire)

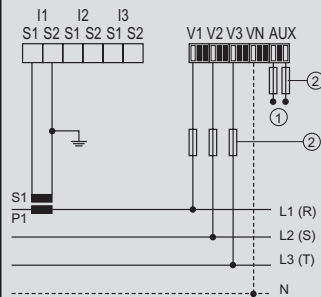

Single-phase network (2-wire)

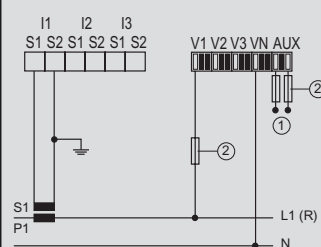


Two-phase network (2-wire)

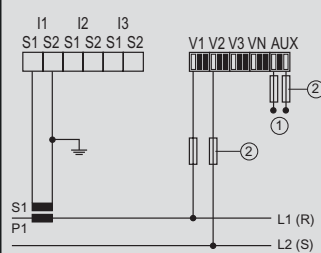

① Auxiliary power supply: 110 ... 400 VAC/120 ... 350 VDC
 ② Fuse: 0.5 A gG/BS 88 2 A gG/0.5 A class CC

Wiring example of communication network

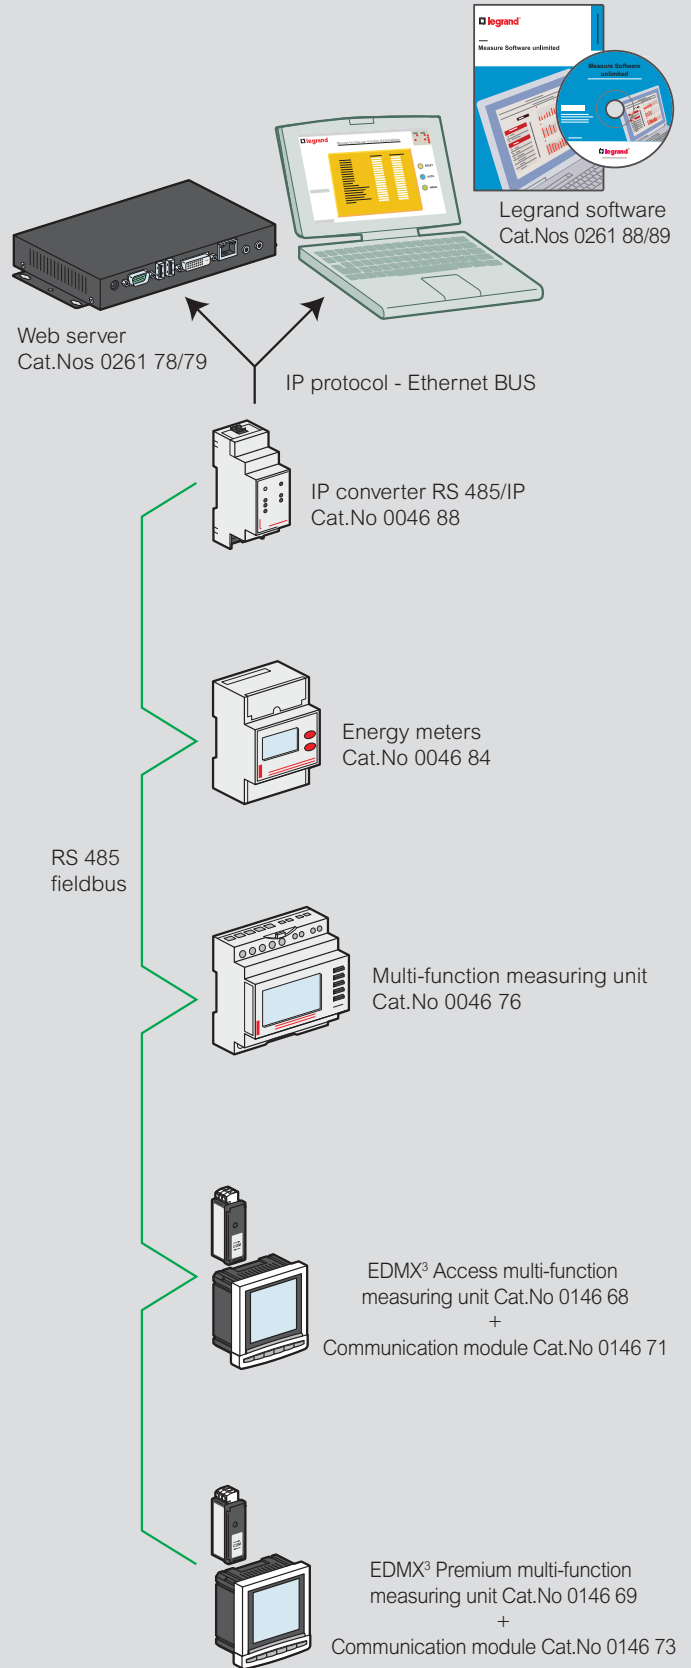

Surge Protective Devices (SPDs)

protection against transient overvoltages

Protection against lightning and overvoltages

Protection against the effects of lightning is essentially based on:

- Protecting buildings using a lightning protection system (LPS or lightning conductors) to catch lightning strikes and to drive the lightning current to earth.
- The use of surge protective devices (SPDs) to protect equipment.
- The design of the earthing system (passive protection of the installation).

Throughout the world, there are millions of lightning strikes each day in the summer (up to 1000 lightning strikes/second). Lightning is responsible for 25% to 40% of all damage to equipment. When added to industrial overvoltages (switching overvoltages due to the operation of internal equipment), they account for more than 60% of all electrical damages, which can be prevented by installing SPDs (according to the country and type of installation - source: insurance companies).

In some countries, and depending on the end use of the building, national regulations may always stipulate the installation of SPDs (for example, Germany, Austria, Norway, etc.). If there are no specific national regulations, SPDs are usually specified by national installation standards (based on HD/IEC 60364 international installation standards) and EN/IEC 62305 standards.

External lightning protection system (LPS) or lightning conductors: protection of buildings (EN/IEC 62305)

An external lightning protection system (LPS) protects buildings against direct lightning strikes. It is generally based on the use of lightning conductors (single rod, with sparkover device, meshed cage, etc.) and/or the metallic structure of the building.

If there is an LPS or if a lightning risk assessment has been carried out in accordance with EN/IEC 62305 standards, SPDs are generally required in the main distribution board (T1 SPDs) and distribution boards (T2 SPDs).

Determination of the SPDs in the main distribution board in accordance with EN/IEC 62305 and TS/IEC 61643-12 (if there is insufficient information available):

| LPL: Lightning protection level | Total lightning current of the LPS | Min. value of Imp current of the SPD (T1) | Usage practices |
|---------------------------------|------------------------------------|---|---------------------|
| I | 200 kA | 25 kA/pole (IT: 35 kA min.) | Power installations |
| II | 150 kA | 18.5 kA/pole | Rarely used |
| III/IV | 100 kA | 12.5 kA/pole | Small installations |

1: LPL (Lightning Protection Level)

Surge protective device (SPD) (internal protection)

The SPD

- Protects sensitive devices against overvoltages caused by lightning and industrial overvoltages, by limiting the overvoltages to values that are tolerated by the equipment
- Limits the possible harmful consequences in terms of the safety of people (medical equipment installed in the home, security systems, environmental systems, etc.)
- Maximises the continuity of operation of equipment and limits production losses

SPDs and standards

Standards EN/IEC 61643-11

| Type of SPD | | Test waves |
|-------------|---------------|--|
| EN 61643-11 | IEC 61643-11 | |
| Type 1 (T1) | Class I (T1) | Iimp: 10/350 μ s (discharge current) In: 8/20 μ s (nominal current, 15 shocks) |
| Type 2 (T2) | Class II (T2) | I _{max} : 8/20 μ s (discharge current) In: 8/20 μ s (nominal current, 15 shocks) |

T1+T2 SPDs: tested in accordance with both methods.

T1 or T1+T2 SPDs are being increasingly used at the supply origin of installations, even when there is no lightning conductor, as they enable higher energies to be discharged and increase the service life the SPD.

HD/IEC 60364 electrical installation standards

According to articles 443 and 534 of HD/IEC 60364 standards and the TS/IEC 61643-12 guides, the use of SPDs in new or renovated buildings is compulsory at the supply origin of the installation in the following cases:


- Buildings with lightning conductors (T1 SPDs, Iimp \geq 12.5 kA)
- Buildings with totally or partially overhead power supplies in AQ2 geographical areas (article 443.3.2.1 - AQ2: Nk > 25, see map below) and based on a risk assessment taking into account the type of power supply to the building (article 443.3.2.2)

According to article 443.3.2.2, SPDs (Type 2) are also required in the following cases:


- Commercial/industrial buildings, public buildings and services, religious buildings, schools and large residential complexes, etc.
- Hospitals and buildings containing medical equipment and/or security systems for people and property (fire alarm, technical alarms, etc.)

Important: it is advisable to install an SPD when the safety of people may depend on the continuity of service of equipment (even if this is not required by national standards). Although not compulsory according to the installation standards, an SPD should always be installed to protect the communication equipment when there is an SPD on the low voltage power network.

These rules should change in 2015. Please consult Legrand.

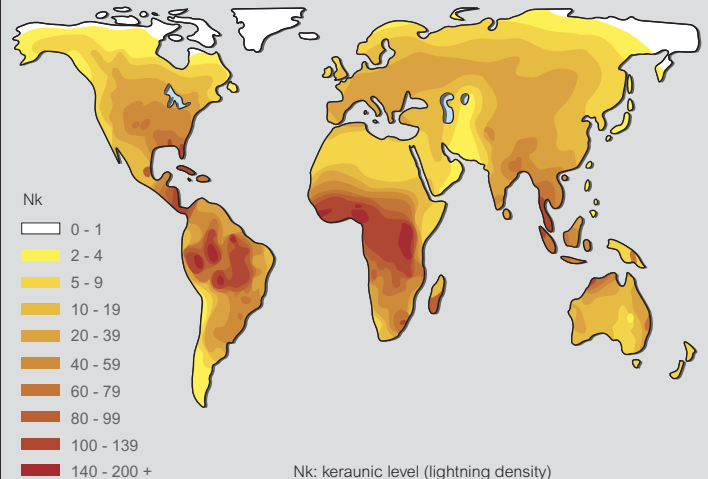

Protection of distribution boards and sensitive equipment (cascaded protection)

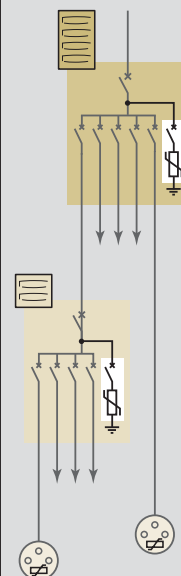

Effective protection against overvoltages cannot generally be assured with a single SPD if its protection level (Up) is greater than 1.2 kV (EN/IEC 62305 and TS/IEC 61643-12).

When there are overvoltages, an SPD protects equipment by limiting these overvoltages to values that can be tolerated by the equipment. Thus, depending on its discharge capacity (discharge current In, I_{max}, etc.) and its protection level (Up), an SPD will limit these overvoltages to varying values depending on the energy levels involved. The overvoltage values that may be transmitted downstream of the SPD may double over distances of more than 10 m due to resonances associated with the type of electrical installation and the type of equipment. Overvoltages greater than 2.5 kV may then occur and damage equipment if the residual energy is high enough (2.5 kV being the insulation level of most electrical and electronic equipment, or typically 1.5 kV for electrical domestic appliances).

SPDs should be installed in the distribution boards supplying equipment that is sensitive or critical for the activity being carried out (and/or near to equipment with proximity SPDs).

Surge Protective Devices (SPDs)

technical characteristics

Modular SPDs

230/400 V~ power network (50/60 Hz) - Degree of protection IP 20

Operating temperature: -10 to +40 °C/Storage temperature: -20 to +70 °C

1P+N (3P+N) SPDs: L-N and N-PE protection, also called 1+1 (3+1 resp.) or CT2 type protection depending on installation standards.

| Cat.Nos | Type | Poles | Earthing system | Max. voltage (Uc) | Protection mode | Nominal current In/pole (8/20) | Max. discharge current | | | Protection level | | Max. short-circuit current I _{sc} (I _{sc} cr) | Protective device to be used ¹ | FS auxiliary (remote status monitoring) | | |
|--------------------|----------------------|-------|------------------|-------------------|-----------------|--------------------------------|-------------------------------|---------------------------------|-------------------------------|--|------------|---|---|---|------------------------------|-----|
| | | | | | | | I _{max} /pole (8/20) | I _{imp} /pole (10/350) | I _t total (10/350) | Up (L-N/L-PE/N-PE) | Up at 5 kA | | | | | |
| 0030 00 4122 80 | T1/50 kA T1/35 kA | 1P | TT, TNC, TNS, IT | 440 V~ | CT1 | 50 kA 35 kA | | 50 kA 35 kA | 50 kA 35 kA | 2.5 kV | | 50 kA | DPX ³ 160 80 A | no | | |
| 4122 81 | T1/25 kA | 1P+N | TT, TNS | 350 V~ | CT2 | 25/50 kA | | 25/50 kA | 50 kA | 1.5/2.5/1.5 kV | | | | yes | | |
| 4122 82 | T1/25 kA | 3P | TNC | 350 V~ | CT1 | 25 kA | | 25 kA | 75 kA | 1.5 kV | | | | yes | | |
| 4122 83 | T1/25 kA | 3P+N | TT, TNS | 350 V~ | CT2 | 25/100 kA | | 25/100 kA | 100 kA | 1.5/2.5/1.5 kV | | | | yes | | |
| 4122 70 | T1+T2/12.5 kA | 1P | TT, TNC, TNS | 320 V~ | CT1 | 25 kA | 60 kA | 12.5 kA | 12.5 kA | 1.5 kV at 12.5 kA 1.9 kV at 25 kA | 1 kV | 50 kA | DX ³ 63 A C curve | no | | |
| 4122 71 | T1+T2/12.5 kA | 2P | TT, TNS | 320 V~ | CT1 | 25 kA | 60 kA | 12.5 kA | 25 kA | | | | | | | no |
| 4122 72 | T1+T2/12.5 kA | 3P | TNC | 320 V~ | CT1 | 25 kA | 60 kA | 12.5 kA | 37.5 kA | | | | | | | yes |
| 4122 73 | T1+T2/12.5 kA | 4P | TT, TNS | 320 V~ | CT1 | 25 kA | 60 kA | 12.5 kA | 50 kA | | | | | no | | |
| 4122 76 | T1+T2/12.5 kA | 1P+N | TT, TNS | 320 V~ | CT2 | 25/25 kA | 60 kA | 12.5/25 kA | 25 kA | 1.5/1.6/1.5 kV at 12.5 kA 1.9/2.1/1.5 kV at 25 kA | 1 kV | | yes | | | |
| 4122 77 | T1+T2/12.5 kA | 3P+N | TT, TNS | 320 V~ | CT2 | 25/50 kA | 60 kA | 12.5/50 kA | 50 kA | | | | | yes | | |
| 4122 50 | T1+T2/8 kA | 1P | TT, TNC, TNS | 320 V~ | CT1 | 20 kA | 50 kA | 8 kA | 8 kA | 1.2 kV at 8 kA 1.7 kV at 20 kA | 1 kV | 50 kA | DX ³ 40 A C curve | no | | |
| 4122 51 | T1+T2/8 kA | 2P | TT, TNS | 320 V~ | CT1 | 20 kA | 50 kA | 8 kA | 16 kA | | | | | | | no |
| 4122 52 | T1+T2/8 kA | 3P | TNC | 320 V~ | CT1 | 20 kA | 50 kA | 8 kA | 25 kA | | | | | | | no |
| 4122 53 | T1+T2/8 kA | 4P | TT, TNS | 320 V~ | CT1 | 20 kA | 50 kA | 8 kA | 32 kA | | | | | no | | |
| 4122 56 | T1+T2/8 kA | 1P+N | TT, TNS | 320 V~ | CT2 | 20 kA | 50 kA | 8 kA | 16 kA | 1.2/1.5/1.5 kV at 8 kA 1.7/2/1.5 kV at 20 kA | 1 kV | | no | | | |
| 4122 57 | T1+T2/8 kA | 3P+N | TT, TNS | 320 V~ | CT2 | 20 kA | 50 kA | 8 kA | 25 kA | | | | | no | | |
| 4122 40 | T2/40 kA | 1P | TT, TNC, TNS | 320 V~ | CT1 | 20 kA | 40 kA | | | 1.5 kV at 15 kA 1.7 kV at 20 kA | 1 kV | 50 kA | DX ³ 25 A C curve | no | | |
| 4122 41 | T2/40 kA | 2P | TT, TNS | 320 V~ | CT1 | 20 kA | 40 kA | | | | | | | | | no |
| 4122 42 | T2/40 kA | 3P | TNC | 320 V~ | CT1 | 20 kA | 40 kA | | | | | | | | | yes |
| 4122 43 | T2/40 kA | 4P | TT, TNS | 320 V~ | CT1 | 20 kA | 40 kA | | | | | | | | | no |
| 4122 46 4122 66 | T2/40 kA | 1P+N | TT, TNS | 320 V~ | CT2 | 20 kA | 40 kA | | | 1.5/1.6/1.4 kV at 15 kA 1.7/2/1.4 kV at 20 kA | 1 kV | 50 kA 25 kA | DX ³ 25 A C curve | no | | |
| 4122 47 4122 67 | T2/40 kA | 3P+N | TT, TNS | 320 V~ | CT2 | 20 kA | 40 kA | | | | | | | | | no |
| 4122 30 | T2/40 kA | 1P | TT, TNC, TNS, IT | 440 V~ | CT1 | 20 kA | 40 kA | | | 1.8 kV at 15 kA 2.1 kV at 20 kA | 1.3 kV | | | 50 kA | DX ³ 25 A C curve | no |
| 4122 32 | T2/40 kA | 3P | TNC, IT | 440 V~ | CT1 | 20 kA | 40 kA | | | | | | | | | |
| 4122 33 | T2/40 kA | 4P | TT, TNS, IT | 440 V~ | CT1 | 20 kA | 40 kA | | | | | | | | | yes |
| 4122 20 | T2/20 kA | 1P | TT, TNS | 320 V~ | CT1 | 10 kA | 20 kA | | | 1.2 kV at 5 kA 1.4 kV at 10 kA | 1.2 kV | 25 kA | DX ³ 20 A C curve | no | | |
| 4122 21 | T2/20 kA | 2P | TT, TNS | 320 V~ | CT1 | 10 kA | 20 kA | | | | | | | | | no |
| 4122 23 | T2/20 kA | 4P | TT, TNS | 320 V~ | CT1 | 10 kA | 20 kA | | | | | | | | | no |
| 4122 26 4122 62 | T2/20 kA | 1P+N | TT, TNS | 320 V~ | CT2 | 10/20 kA | 20 kA | | | 1.2/1.4/1.4 kV at 5 kA 1.4/1.4/1.4 kV at 10 kA | 1.2 kV | | | | no | |
| 4122 27 4122 63 | T2/20 kA | 3P+N | TT, TNS | 320 V~ | CT2 | 10/20 kA | 20 kA | | | | | | | no | | |
| 0039 51 0039 71 | T2+T3/12 kA | 1P+N | TT, TNS | 275 V~ | CT2 | 10/10 kA | 12 kA | | | 1.1/1.2/1.2 kV at 10 kA | 1 kV | 6 kA 10 kA | integrated protection | no | | |
| 0039 53 0039 73 | T2+T3/12 kA | 3P+N | TT, TNS | 275 V~ | CT2 | 10/20 kA | 20 kA | | | | | | | | | |

CT1: L(N)-PE protection modes.

CT2: L-N and N-PE protection modes.

1: DPX³ (with T1 SPDs), DX³ or similar type circuit breakers (with T2 and T1+T2 SPDs). For fuse protection or values other than those indicated in the table: please consult Legrand.

Characteristics of proximity SPDs

230 V~ protection: Type 3 (T3) SPDs

| Cat.Nos | 0775 40 | 6946 64/66/70 | 6946 14/48/51/56/71 |
|------------------|----------|---------------|---------------------|
| Protection mode | LN/NPE | LN/LPE/NPE | LN |
| Up | 1/1.2 kV | 1 kV | 1 kV |
| I _{max} | 6 kA | - | - |
| I _n | 1.5 kA | 2 kA | 2 kA |
| U _{oc} | 3 kV | 4 kV | 4 kV |

TT earthing system: Installation downstream of a residual current device (HPI type recommended).

RJ 45/RJ 11 protection

| Cat. No. | 6946 64 | 6946 70 |
|------------------|---------|---------|
| U _c | | 200 V |
| U _p | | 600 V |
| I _{max} | | 1.5 kA |
| I _n | | 1 kA |
| U _{oc} | | 3 kV |

TV protection (9.5 mm coax.)

| Cat. No. | 6946 66 |
|------------------|---------|
| U _c | 50 V |
| U _p | 900 V |
| I _{max} | 5 kA |
| I _n | 1 kA |
| U _{oc} | 3 kV |

Surge Protective Devices (SPDs)


technical characteristics

Installation

Associated overcurrent protection

SPDs must be protected by a circuit breaker (or fuses), to provide protection in the event of an overload, which may make the SPD reach its end of life (see selection table p. 10-11). This protective device will be defined to be coordinated or discriminating with regard to upstream protective devices.

Connection principles

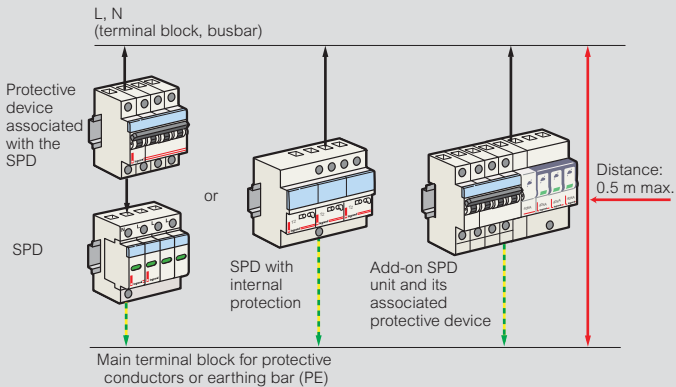


Connection lengths: as short as possible (< 50 cm if possible).
EMC (Electromagnetic Compatibility) rules: avoid loops, fix the cables firmly against the exposed metal conductive parts of the enclosure.

SPD types and earthing systems


When possible (according to local rules), the SPD and its associated overcurrent protection (P2) should be installed upstream of the main protection (P1) as shown below (according to standards HD/IEC 60364).

SPDs and TT earthing system

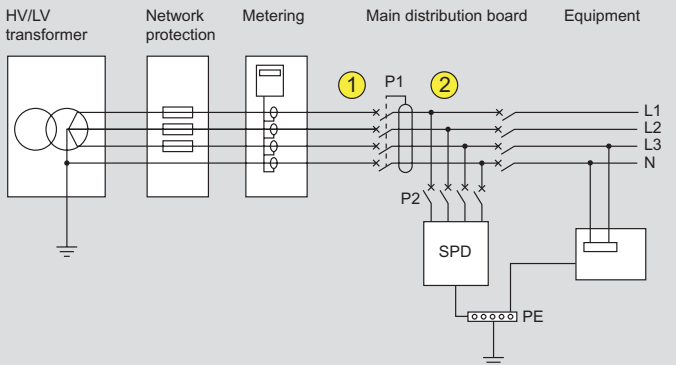


P1: main protection of the installation
SPD: surge protective device with U_c 275 or 320 V recommended
① (upstream of P1): 1P+N/3P+N SPDs only (except for Cat.Nos 0039 51/53/71/73).
1P/2P/3P/4P SPDs and Cat.Nos 0039 51/53/71/73 must always be installed downstream of a residual current device (discriminating or delayed, at the supply end of the installation).
② (downstream of P2): any SPD.

SPDs and TN (TNC, TNS and TNC-S) earthing systems

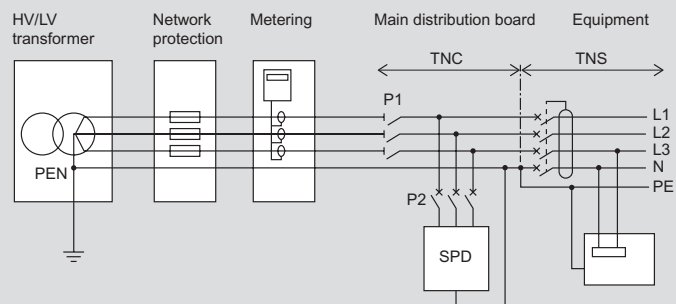

P1: main protection of the installation
SPD: surge protective device with U_c 275 or 320 V recommended

SPDs and IT earthing system

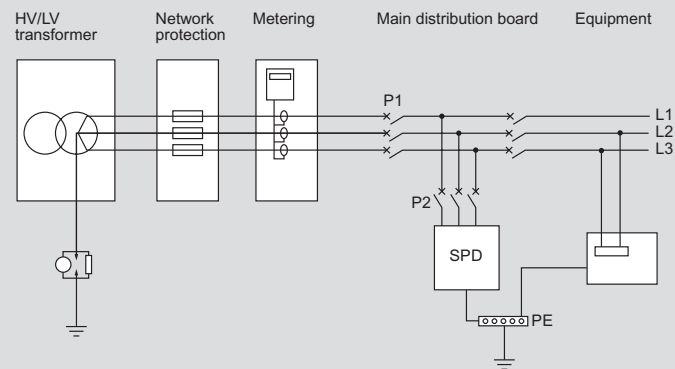

P1: main protection of the installation
SPD: surge protective device with U_c 440 V ($U_c < 440$ V prohibited)

Coordinating upstream/downstream SPDs

Consists of ensuring that any downstream SPD (in distribution enclosures or proximity SPDs) is correctly coordinated in energy terms with any SPD located upstream (TS 61643-12).

Minimum distances between SPDs

| Upstream SPD | Downstream SPD | Min. distance (m) |
|------------------|----------------|-------------------|
| T1/50 and T1/25 | T2/40 | 10 |
| T1/12.5 and T1/8 | T2/40 | 6 |
| | T2/20, T2/12 | 8 |
| T2/40 | T2/20 | 4 |
| | T2/12 | 6 |
| T2/20 and T2/12 | Proximity SPD | 2 |

If it is not possible to comply with these distances, insert decoupling inductors on each phase and neutral conductor.