

Current transformer 0.3...3 A for 3RB22/23/24 Size S00/S0 Stand-alone installation Main circuit: straight-through transformer Auxiliary circuit: --



Product brand name	SIRIUS
Product designation	Current measuring module
General technical data	
Type of protection	PTB 05 ATEX 3022 Ex II (2) GD
Main circuit	
Adjustable pick-up value current of the current-dependent overload release	0.3 ... 3 A
Installation/ mounting/ dimensions	
Mounting type	stand-alone installation
Connections/Terminals	
Type of electrical connection	straight-through transformers
• for main current circuit	
Certificates/approvals	

General Product Approval	For use in hazardous locations	Declaration of Conformity
--------------------------	--------------------------------	---------------------------



CCC



CSA



UL



ATEX



EG-Konf.

Test Certificates	Marine / Shipping
-------------------	-------------------

[Special Test Certificate](#)



ABS



BUREAU VERITAS



LRS



RINA



DNV-GL

other

[Confirmation](#)

Further information

Information- and Downloadcenter (Catalogs, Brochures,...)

<http://www.siemens.com/industrial-controls/catalogs>

Industry Mall (Online ordering system)

<https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3RB2906-2BG1>

Cax online generator

<http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RB2906-2BG1>

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<https://support.industry.siemens.com/cs/ww/en/ps/3RB2906-2BG1>

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...)


http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RB2906-2BG1&lang=en

Characteristic: Tripping characteristics, I^t, Let-through current

<https://support.industry.siemens.com/cs/ww/en/ps/3RB2906-2BG1/char>

Further characteristics (e.g. electrical endurance, switching frequency)

<http://www.automation.siemens.com/bilddb/index.aspx?view=Search&mlfb=3RB2906-2BG1&objecttype=14&gridview=view1>

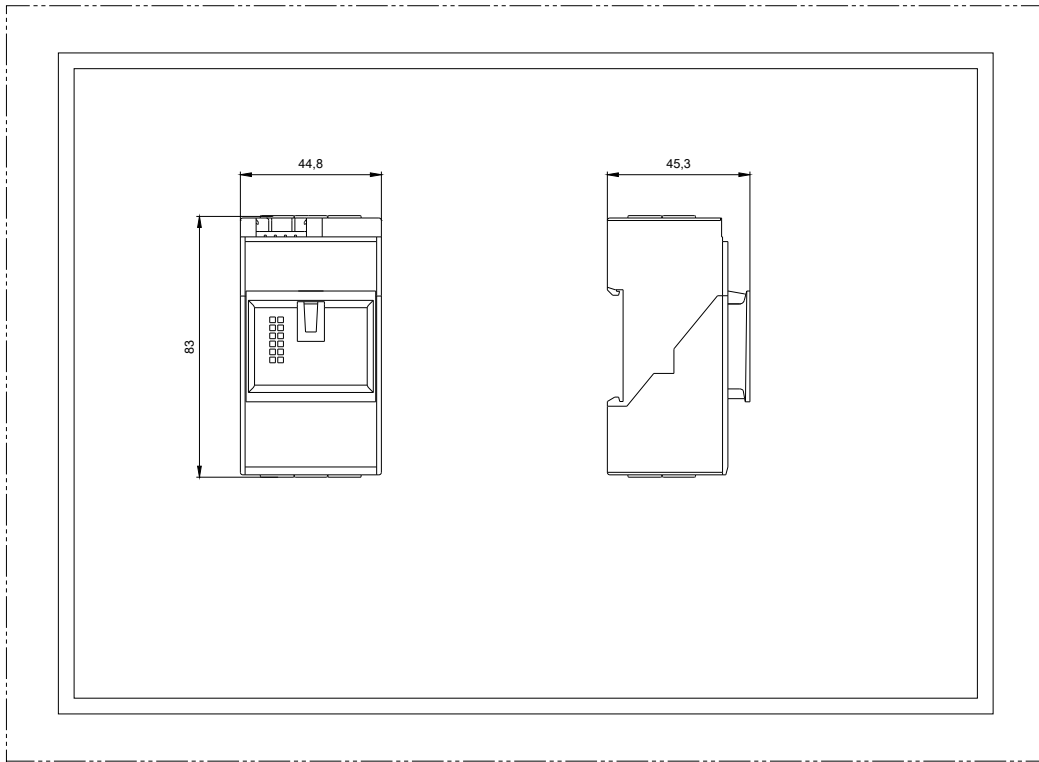

last modified:

07/16/2018