SIEMENS

Data sheet 3RB3123-4NB0

Overload relay 0.32...1.25 A Electronic For motor protection Size S0, Class 5...30 Contactor mounting Main circuit: Screw Auxiliary circuit: Screw Manual-Automatic-Reset Internal ground fault detection



Product brand name	SIRIUS
Product designation	solid-state overload relay
Product type designation	3RB3

Size of overload relay	S0
Size of contactor can be combined company-specific	S0
Power loss [W] for rated value of the current	
• at AC in hot operating state	0.1 W
• at AC in hot operating state per pole	0.03 W
Insulation voltage with degree of pollution 3 at AC rated value	690 V
Surge voltage resistance rated value	6 kV
maximum permissible voltage for safe isolation	
 in networks with grounded star point between auxiliary and auxiliary circuit 	300 V
 in networks with grounded star point between auxiliary and auxiliary circuit 	300 V
 in networks with grounded star point between main and auxiliary circuit 	600 V

 in networks with grounded star point between main and auxiliary circuit 	690 V
Protection class IP	
• on the front	IP20
 of the terminal 	IP20
Shock resistance	15g / 11 ms
• acc. to IEC 60068-2-27	15g / 11 ms; Signaling contact 97 / 98 in position "Tripped": 9g / 11 ms
Vibration resistance	1-6 Hz, 15 mm; 6-500 Hz, 20 m/s ² ; 10 cycles
Thermal current	1.25 A
Recovery time	
 after overload trip with automatic reset typical 	3 min
 after overload trip with remote-reset 	0 min
 after overload trip with manual reset 	0 min
Type of protection according to ATEX directive 2014/34/EU	Ex II (2) G [Ex e] [Ex d] [Ex px]; Ex II (2) D [Ex t] [Ex p]
Certificate of suitability according to ATEX directive 2014/34/EU	PTB 09 ATEX 3001
Reference code acc. to DIN EN 81346-2	F
Ambient conditions	
Installation altitude at height above sea level	
• maximum	2 000 m
Ambient temperature	
during operation	-25 +60 °C
during storage	-40 +80 °C
 during transport 	-40 +80 °C
Temperature compensation	-25 +60 °C
Relative humidity during operation	10 95 %
Main circuit	
Number of poles for main current circuit	3
Adjustable pick-up value current of the current- dependent overload release	0.32 1.25 A
Operating voltage	
• rated value	690 V
• for remote-reset function at DC	24 V
● at AC-3 rated value maximum	690 V
Operating frequency rated value	50 60 Hz
Operating current rated value	1.25 A
Operating power	
• for three-phase motors at 400 V at 50 Hz	0.12 0.37 kW
• for AC motors at 500 V at 50 Hz	0.12 0.55 kW
• for AC motors at 690 V at 50 Hz	0.18 0.75 kW

Auxiliary circuit	
Design of the auxiliary switch	integrated
Number of NC contacts for auxiliary contacts	1
• Note	for contactor disconnection
Number of NO contacts for auxiliary contacts	1
• Note	for message "tripped"
Number of CO contacts	
• for auxiliary contacts	0
Operating current of auxiliary contacts at AC-15	
• at 24 V	4 A
● at 110 V	4 A
● at 120 V	4 A
● at 125 V	4 A
● at 230 V	3 A
Operating current of auxiliary contacts at DC-13	
● at 24 V	2 A
● at 60 V	0.55 A
● at 110 V	0.3 A
● at 125 V	0.3 A
● at 220 V	0.11 A
Protective and monitoring functions	
Trip class	CLASS 5E, 10E, 20E and 30E adjustable
Trip class Design of the overload release	CLASS 5E, 10E, 20E and 30E adjustable electronic
Trip class	electronic
Trip class Design of the overload release Response value current • of the ground fault protection minimum	electronic 0.75 x IMotor
Trip class Design of the overload release Response value current	electronic
Trip class Design of the overload release Response value current • of the ground fault protection minimum Response time of the ground fault protection in	electronic 0.75 x IMotor
Trip class Design of the overload release Response value current • of the ground fault protection minimum Response time of the ground fault protection in settled state Operating range of the ground fault protection	electronic 0.75 x IMotor
Trip class Design of the overload release Response value current • of the ground fault protection minimum Response time of the ground fault protection in settled state Operating range of the ground fault protection relating to current setting value	electronic 0.75 x IMotor 1 000 ms
Trip class Design of the overload release Response value current • of the ground fault protection minimum Response time of the ground fault protection in settled state Operating range of the ground fault protection relating to current setting value • minimum • maximum UL/CSA ratings	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value
Trip class Design of the overload release Response value current of the ground fault protection minimum Response time of the ground fault protection in settled state Operating range of the ground fault protection relating to current setting value minimum maximum UL/CSA ratings Full-load current (FLA) for three-phase AC motor	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5
Trip class Design of the overload release Response value current • of the ground fault protection minimum Response time of the ground fault protection in settled state Operating range of the ground fault protection relating to current setting value • minimum • maximum UL/CSA ratings	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5
Trip class Design of the overload release Response value current of the ground fault protection minimum Response time of the ground fault protection in settled state Operating range of the ground fault protection relating to current setting value minimum maximum UL/CSA ratings Full-load current (FLA) for three-phase AC motor at 480 V rated value at 600 V rated value	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 1.25 A 1.25 A
Trip class Design of the overload release Response value current • of the ground fault protection minimum Response time of the ground fault protection in settled state Operating range of the ground fault protection relating to current setting value • minimum • maximum UL/CSA ratings Full-load current (FLA) for three-phase AC motor • at 480 V rated value	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5
Trip class Design of the overload release Response value current of the ground fault protection minimum Response time of the ground fault protection in settled state Operating range of the ground fault protection relating to current setting value minimum maximum UL/CSA ratings Full-load current (FLA) for three-phase AC motor at 480 V rated value at 600 V rated value Contact rating of auxiliary contacts according to UL Short-circuit protection	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 1.25 A 1.25 A
Trip class Design of the overload release Response value current • of the ground fault protection minimum Response time of the ground fault protection in settled state Operating range of the ground fault protection relating to current setting value • minimum • maximum UL/CSA ratings Full-load current (FLA) for three-phase AC motor • at 480 V rated value • at 600 V rated value Contact rating of auxiliary contacts according to UL Short-circuit protection Design of the fuse link	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 1.25 A 1.25 A
Trip class Design of the overload release Response value current of the ground fault protection minimum Response time of the ground fault protection in settled state Operating range of the ground fault protection relating to current setting value minimum maximum UL/CSA ratings Full-load current (FLA) for three-phase AC motor at 480 V rated value at 600 V rated value Contact rating of auxiliary contacts according to UL Short-circuit protection	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 1.25 A 1.25 A B600 / R300
Trip class Design of the overload release Response value current • of the ground fault protection minimum Response time of the ground fault protection in settled state Operating range of the ground fault protection relating to current setting value • minimum • maximum UL/CSA ratings Full-load current (FLA) for three-phase AC motor • at 480 V rated value • at 600 V rated value Contact rating of auxiliary contacts according to UL Short-circuit protection Design of the fuse link	electronic 0.75 x IMotor 1 000 ms IMotor > lower current setting value IMotor < upper current setting value x 3.5 1.25 A 1.25 A

• for short-circuit protection of the auxiliary switch required

fuse gG: 6 A

nstallation/ mounting/ dimensions Mounting position	any
Mounting type	Contactor mounting
Height	87 mm
Width	45 mm
Depth	84 mm
Depui	04 111111
Connections/ Terminals	
Product function	
 removable terminal for auxiliary and control circuit 	Yes
Type of electrical connection	
• for main current circuit	screw-type terminals
 for auxiliary and control current circuit 	screw-type terminals
Arrangement of electrical connectors for main current circuit	Top and bottom
Type of connectable conductor cross-sections	
• for main contacts	
— solid	2x (1 2.5 mm²), 2x (2.5 10 mm²)
— stranded	2x 10 mm²
 single or multi-stranded 	1x (1 10 mm²), 2x (1 10 mm²)
— finely stranded with core end processing	1x (1 6 mm²), 2 x (1 6 mm²), 1x 10 mm²
 at AWG conductors for main contacts 	1x (16 8), 2x (16 8)
Type of connectable conductor cross-sections	
• for auxiliary contacts	
— solid	1x (0.5 4 mm²), 2x (0.5 2.5 mm²)
 single or multi-stranded 	1x (0,5 4 mm²), 2x (0,5 2,5 mm²)
 finely stranded with core end processing 	1x (0.5 2.5 mm²), 2x (0.5 1.5 mm²)
• at AWG conductors for auxiliary contacts	1x (20 14), 2x (20 14)
Tightening torque	
• for main contacts with screw-type terminals	2 2.5 N·m
• for auxiliary contacts with screw-type terminals	0.8 1.2 N·m
Design of screwdriver shaft	Diameter 5 to 6 mm
Size of the screwdriver tip	Pozidriv PZ 2
Design of the thread of the connection screw	
• for main contacts	M4
• of the auxiliary and control contacts	M3
Communication/ Protocol	
Type of voltage supply via input/output link master	No

Conducted interference

- due to burst acc. to IEC 61000-4-4
- due to conductor-earth surge acc. to IEC 61000-4-5
- due to conductor-conductor surge acc. to IEC 61000-4-5
- due to high-frequency radiation acc. to IEC 61000-4-6

Field-bound parasitic coupling acc. to IEC 61000-4-3

Electrostatic discharge acc. to IEC 61000-4-2

2 kV (power ports), 1 kV (signal ports) corresponds to degree of severity 3

2 kV (line to earth) corresponds to degree of severity 3

1 kV (line to line) corresponds to degree of severity 3

10 V in frequency range 0.15 to 80 MHz, modulation 80 % AM with 1 kHz

10 V/m

6 kV contact discharge / 8 kV air discharge

Display

Display version

• for switching status

Slide switch

Certificates/ approvals

General Product Approval

EMC

For use in hazardous locations













Declaration of Conformity

Test Certificates

Marine / Shipping



Miscellaneous

Special Test Certificate

Type Test Certificates/Test Report





Marine / Shipping

other













Confirmation

Further information

Information- and Downloadcenter (Catalogs, Brochures,...)

https://www.siemens.com/ic10

Industry Mall (Online ordering system)

https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3RB3123-4NB0

Cax online generator

http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RB3123-4NB0


Service&Support (Manuals, Certificates, Characteristics, FAQs,...)


https://support.industry.siemens.com/cs/ww/en/ps/3RB3123-4NB0


Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...) http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RB3123-4NB0&lang=en


Characteristic: Tripping characteristics, I2t, Let-through current https://support.industry.siemens.com/cs/ww/en/ps/3RB3123-4NB0/char

Further characteristics (e.g. electrical endurance, switching frequency)
http://www.automation.siemens.com/bilddb/index.aspx?view=Search&mlfb=3RB3123-4NB0&objecttype=14&gridview=view1

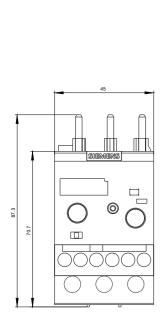

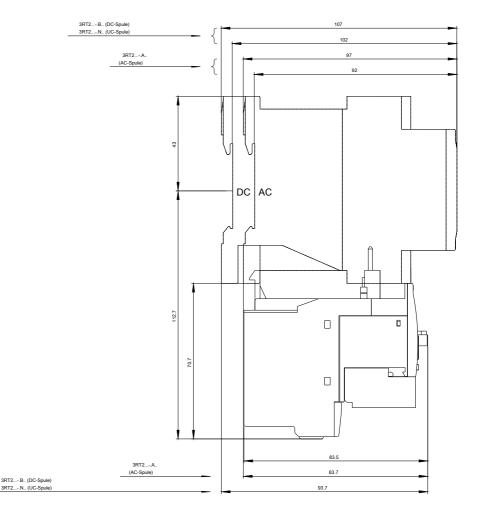

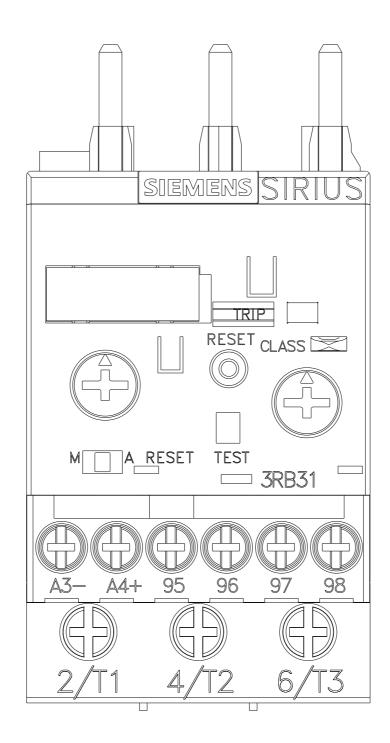

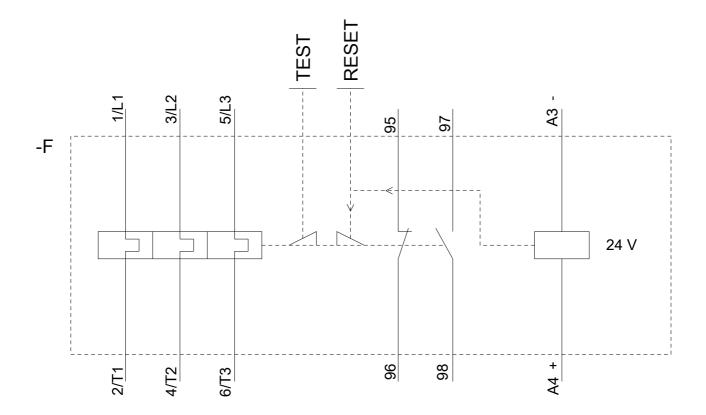

last modified: 04/07/2020