

Data sheet for motors


Manufacturer	Bharat Bijlee Ltd.			Customer	
Type of motor	3 Phase Induction Motor			BBL Enquiry reference No	
Quantity				Customer P.O.Number	
Application	CUSTOMER TO FURNISH			W.O. No. / SAP No.	
Tag no.				Output kW / pole	0.37 / 4P
BBL type tef.				Frame size	71
Installation details				Applicable standards (latest edition)	
Area classification (Safe / Hazardous)	Industrial safe area			Performance: IS/IEC 60034-1 Maintenance IS:900	
Location: indoor/outdoor/deck	Indoor			Dimensions: IS 1231/IS 2223/IS:8223	
Altitude (meters)	1000 or less			Vibrations: IS 12075	
				Noise level: IS 12065	
Hazardous area details				Supply conditions and permissible variations (grid supply)	
Area classification GAS (Zone 1/Zone 2)	N.A.			Number of phases	Three
Gas group	N.A.			Voltage (Volts) and permissible variation	415 ±10%
Temp.class	N.A.			Frequency (Hz) and permissible variation	50 ±5%
Type of Explosion protection (FLP/Type 'e'/Type 'n')	N.A.			Combined variation (absolute sum)	±10%
Approving authority for hazardous area	Not Applicable				
Electrical parameters					
Starting performance					
Method of starting	DOL			Starting current (%FLC)	350
Load speed (rpm)	CUSTOMER TO FURNISH			Starting torque (%FLT)	200
Motor GD ² (kgm ²)	0.0031			Pull out torque (%FLT)	220
Load GD ² (kgm ²)	CUSTOMER TO FURNISH			Locked rotor withstand time (hot/cold) (sec)	30 / 60
Load torque-speed curve	Parabolic TS curve			Number of consecutive starts (hot/cold) (nos.) provided Load GD2 = Motor GD2	2 / 3
Starting time at rated voltage (sec)	PLEASE FURNISH ALL ABOVE DETAILS				
Running Performance					
Efficiency class	IE2			Duty and designation	Continuous (S1)
Ambient temp./temp.rise by resistance (deg.C)	50 / 70			CDF/Equivalent starts per hour/FI	-
Enclosure	TEFC (TOTALLY ENCLOSED FAN COOLED)			Insulation class / utilisation class on DOL	F/B
Full load current (FLC) amps.	1			Rotor type (Squirrel Cage/ Slip ring)	Squirrel Cage
Full load speed (rpm)	1400			Rotor voltage/rotor current (RV/RA) (Volts/Amps)	Not applicable
Full load torque (FLT) kg-m	0.26			Stator/rotor time constant (min)	72/97
Efficiency in % at FL/0.75FL/0.5FL	72.7	72.7	70.0	Power factor at FL/0.75FL/0.5FL	0.68 0.58 0.47
Mechanical parameters					
Mounting	B3/B5			Mounting dimensions	Refer GA drawing
Shaft extention	Single cylindrical			Direction of rotation viewed from DE	Clockwise
Degree of protection	IP 55			Suitable for bidirectional rotation	Yes
Method of cooling (TEFC/forced cooled/TEFC)	TEFC (IC 411)			Paint type	Acrylic
Net weight of motor (kgs.)	8			Paint shade	RAL 5000
				Earthing provision (two terminals on stator body)	Yes
Bearings					
Terminal box					
Coupling (Direct/flexible/Belt & Pulley/Gearbox)	Direct			Terminal box location when viewed from DE	As per GA drawing
Dimensions of pulley (OD x width) mm	-			Direction of cable entry	As per GA drawing
Bearings (roller/ball/angular contact)	Ball /Ball			Cable size and type(Aluminium)	1R X 3C X 4 SQ MM
Bearing size DE/NDE	6202 2Z C3	/	6202 2Z C3	Earthing provision (one terminal in TB)	Yes
Type of lubrication	LITHIUM SOAP BASE GREASE			No of phases/Winding connection/number of terminals	3 / STAR / 6
Accessories					
RTDs - 3 numbers simplex (w/o controller)				Arrow plate for direction of rotation	
BTDS - 1 number per bearing (w/o controller)				Double compression glands (main cable)	
Space heaters - single phase 50z, 230V				Double compression glands (Space heater/thermistors/RTDs)	
Thermistors - PTC , 1 number per phase				Brake (Type/voltage/torque)	
Additional T-Box for Accessories					
Additional nameplate					
Notes:					
1)All performance values are subject to IS/IEC 60034-1 tolerances, unless otherwise specified.					
2)Performance values are at rated voltage and rated frequency condition and for DOL starting condition.					
3)Motor GD ² = Load GD ² assumed wherever not mentioned.					
4)Where starting time is more than 10 seconds, provision of heavy duty relays is mandatory.					
5)Kilowatt rating is mandatory and HP is approximate.					
6) Accessories provided are marked as "YES"					
				Prepared by	
				Approved by	
				Revision	
Project:		Contractor/Client		Date:	
Consultant		Package			

Customer : -	BBL Ref No.: -	Quantity : -
Consultant : -	Tag Nos. : --	
Project : -		

Output (kW)/Poles : 0.37 / 4P	Frame : 71
-------------------------------	------------

Torque & Current Vs Speed Curve

- Current Vs Speed at 110% V
- Current Vs Speed at 100% V
- • - Current Vs Speed at 80% V
- - - Torque Vs Speed at 110% V
- Torque Vs Speed at 100% V
- • - Torque Vs Speed at 80% V

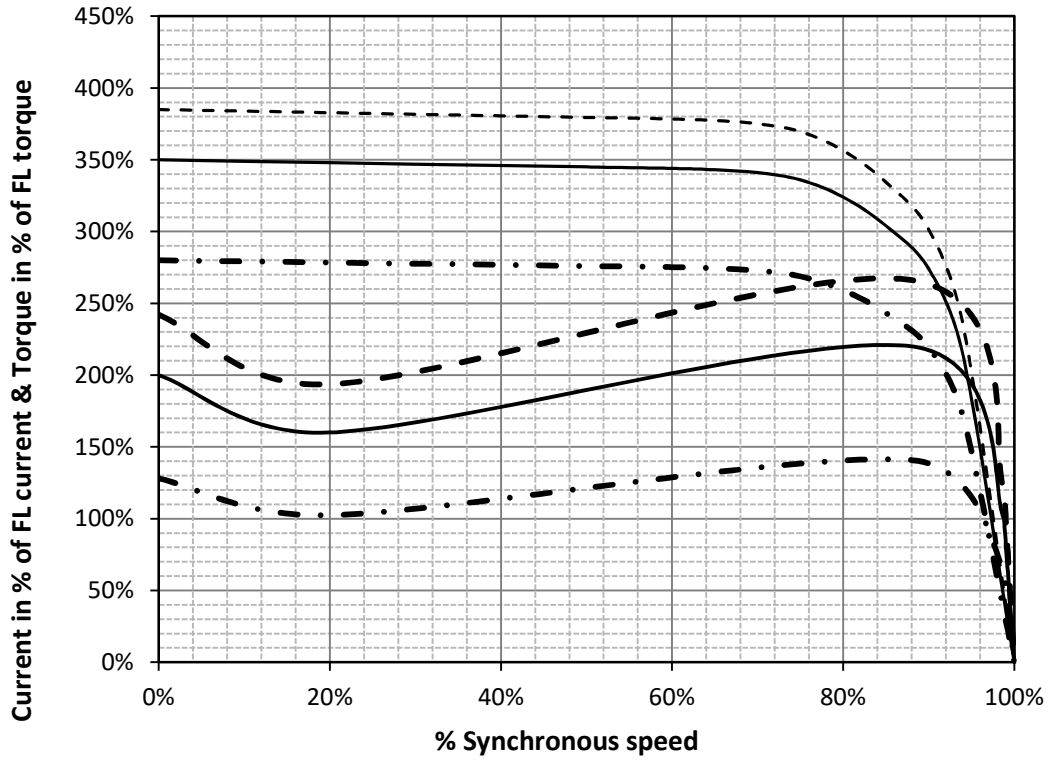


-	-	-	-
Rev No.	Prepared By	Checked By	Date

Customer : -	BBL Ref No.: -	Quantity : -
Consultant : -	Tag Nos. : --	
Project : -		

Output (kW)/Poles : 0.37 / 4P	Frame : 71
-------------------------------	------------

Efficiency, Power Factor Vs Output Curve

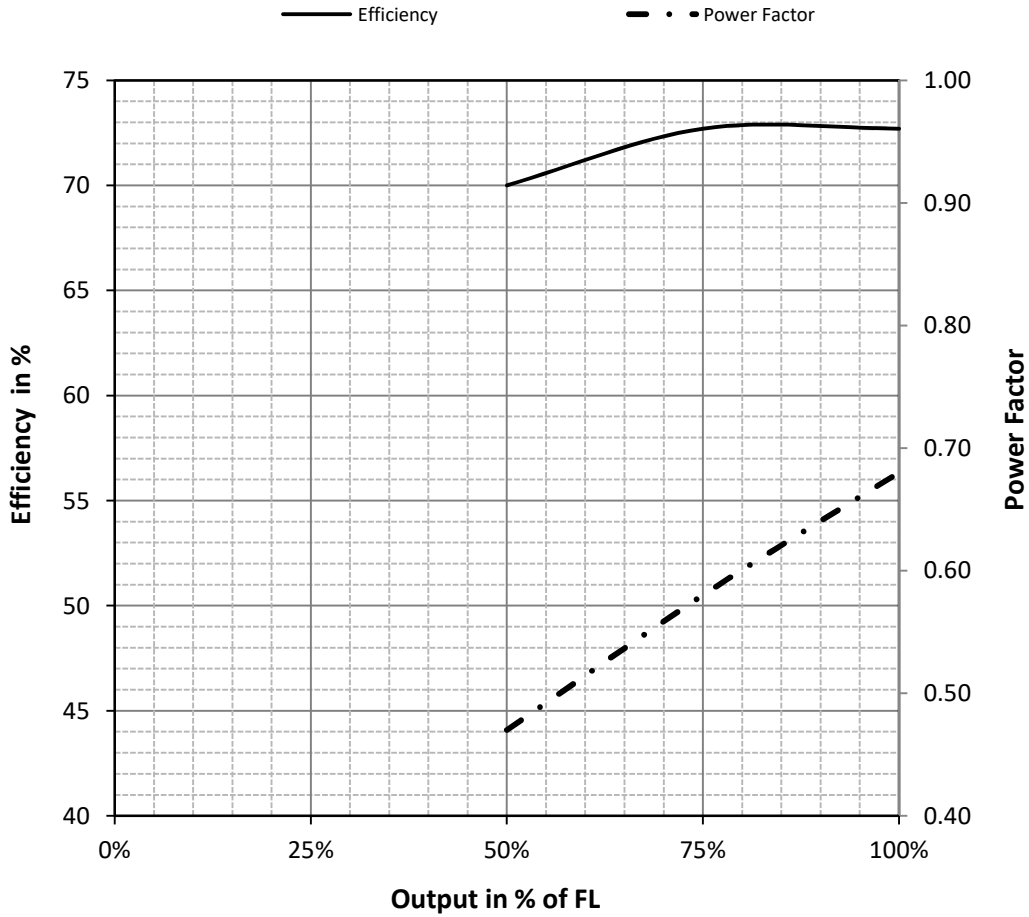


-	-	-	-
Rev No.	Prepared By	Checked By	Date

Customer : -	BBL Ref No.: -	Quantity : -
Consultant : -	Tag Nos. : --	
Project : -		

Output (kW)/Poles : 0.37 / 4P	Frame : 71
-------------------------------	------------

**Thermal Withstand Time
Vs Current Curve**

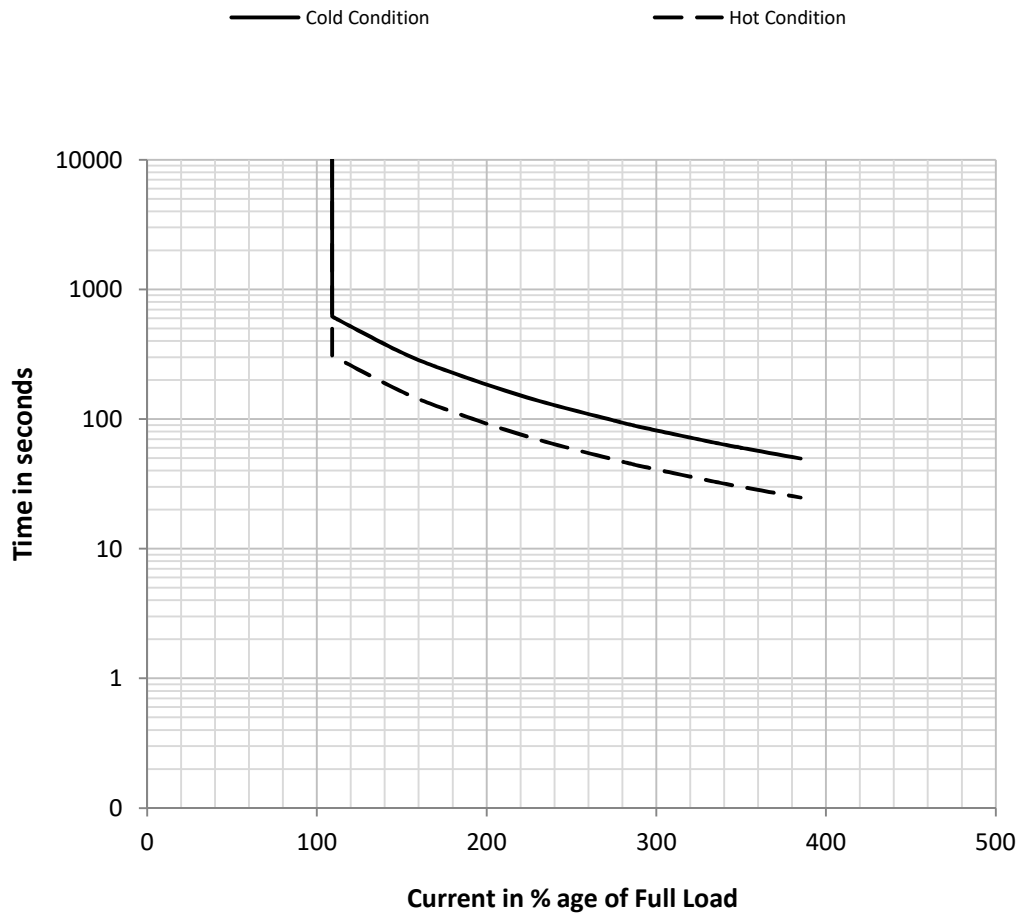

-	-	-	-
Rev No.	Prepared By	Checked By	Date